

7999 Gladys Avenue, Suite 101 Beaumont, Texas 77706 (409) 860-0197 • Fax (409) 860-0198

April 08, 2019

ADDENDUM NO. 1

#15036 – FORD FIELDS CONCESSION STAND BEAUMONT, TEXAS

The following changes, corrections and additions or deletions to the Drawings and Specifications are hereby made part of the Contract Documents. Bidders shall acknowledge receipt of this Addendum in the Bid Form

SPECIFICATIONS

SECTION 133419 – METAL BUILDING SYSTEMS

1. Paragraph 2.1.A: Add the following manufacturer - SBS (Schulte Building Systems).

DRAWINGS

Sheet A1.1

- 1. 2/A1.1 Equipment Schedule Item #34 Notes Delete note in its entirety and revise to read as follows: "Supplied by Owner, Installed by Contractor".
- 2. 2/A1.1 Equipment Schedule Item #35 Notes Delete note in its entirety and revise to read as follows: "Supplied by Owner, Installed by Contractor".

Sheet A2.1

1. Delete Sheet A2.1 in its entirety and replace with the attached revised Sheet A2.1.

Sheet A4.0

1. Delete Sheet A4.0 in its entirety and replace with the attached revised Sheet A4.0.

Sheet A5.0

1. Delete Sheet A5.0 in its entirety and replace with the attached revised Sheet A5.0.

Sheet A6.0

1. Delete Sheet A6.0 in its entirety and replace with the attached revised Sheet A6.0.

Sheet A7.0

1. Delete Sheet A7.0 in its entirety and replace with the attached revised Sheet A7.0.



Sheet ME-1.0

2. Delete Sheet ME-1.0 in its entirety and replace with the attached revised Sheet ME-1.0.

Sheet ME-2.0

1. Delete Sheet ME-2.0 in its entirety and replace with the attached revised Sheet ME-2.0.

Sheet ME-2.1

1. Delete Sheet ME-2.1 in its entirety and replace with the attached revised Sheet ME-2.1.

Sheet ME-2.2

1. Delete Sheet ME-2.2 in its entirety and replace with the attached revised Sheet ME-2.2.

Sheet ME-3.0

1. Delete Sheet ME-3.0 in its entirety and replace with the attached revised Sheet ME-3.0.

Sheet ME-3.1

1. Delete Sheet ME-3.1 in its entirety and replace with the attached revised Sheet ME-3.1.

Sheet ME-3.2

1. Delete Sheet ME-3.2 in its entirety and replace with the attached revised Sheet ME-3.2.

Sheet ME-4.0

1. Delete Sheet ME-4.0 in its entirety and replace with the attached revised Sheet ME-4.0.


Sheet ME-4.1


1. Delete Sheet ME-4.1 in its entirety and replace with the attached revised Sheet ME-4.1.

Sheet ME-4.2

1. Delete Sheet ME-4.2 in its entirety and replace with the attached revised Sheet ME-4.2.

End of Addendum No. 1



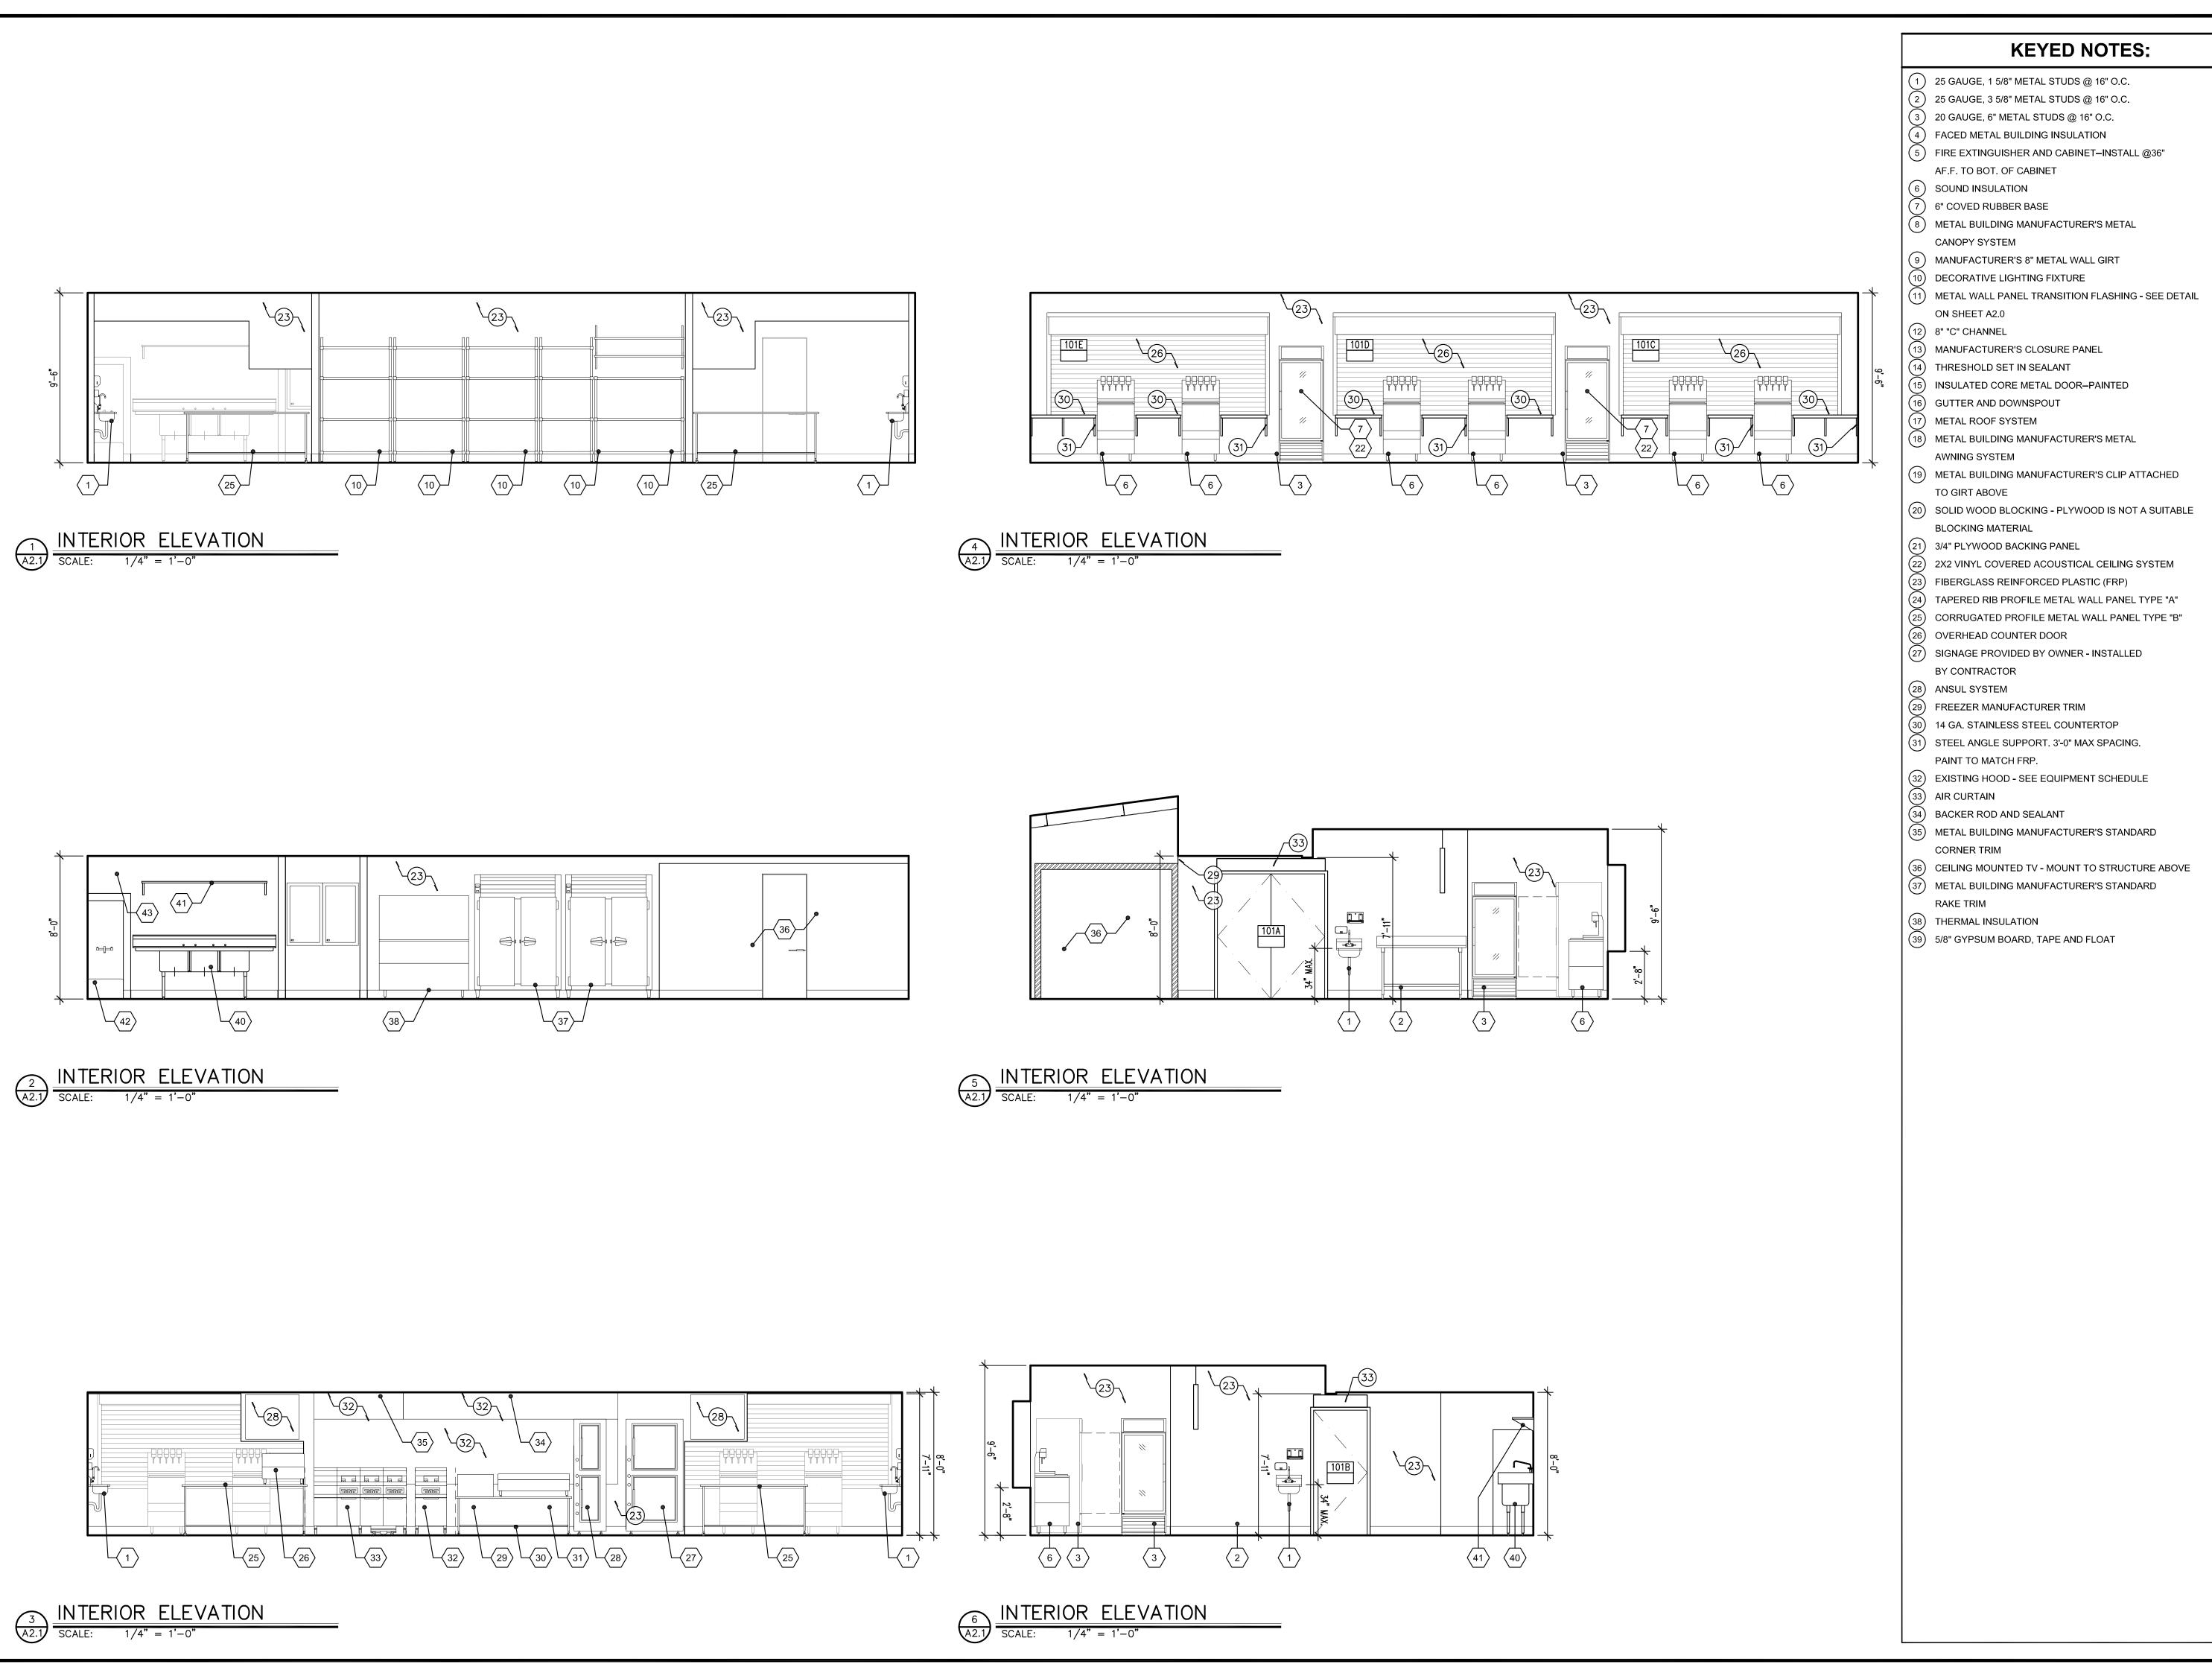


THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN AUTHORIZATION OF THE LaBICHE ARCHITECTURAL GROUP, INC. 03.15.2019 DATE SIGNED 12.31.2019 REGISTRATION EXPIRATION DATE **D** F 55 NEW CONSTRUCTIO


S CONCESSION STANE


5115 IH-10 SOUT


BEAUMONT, TEXAS 7770 DS. CMM PROJECT NUMBER 15036 DOCUMENT RELEASE DATES 03.15.2019 BIDS & CONSTRUCTION


> COPYRIGHT © 2019 THE LABICHE ARCHITECTURAL GROUP, INC.

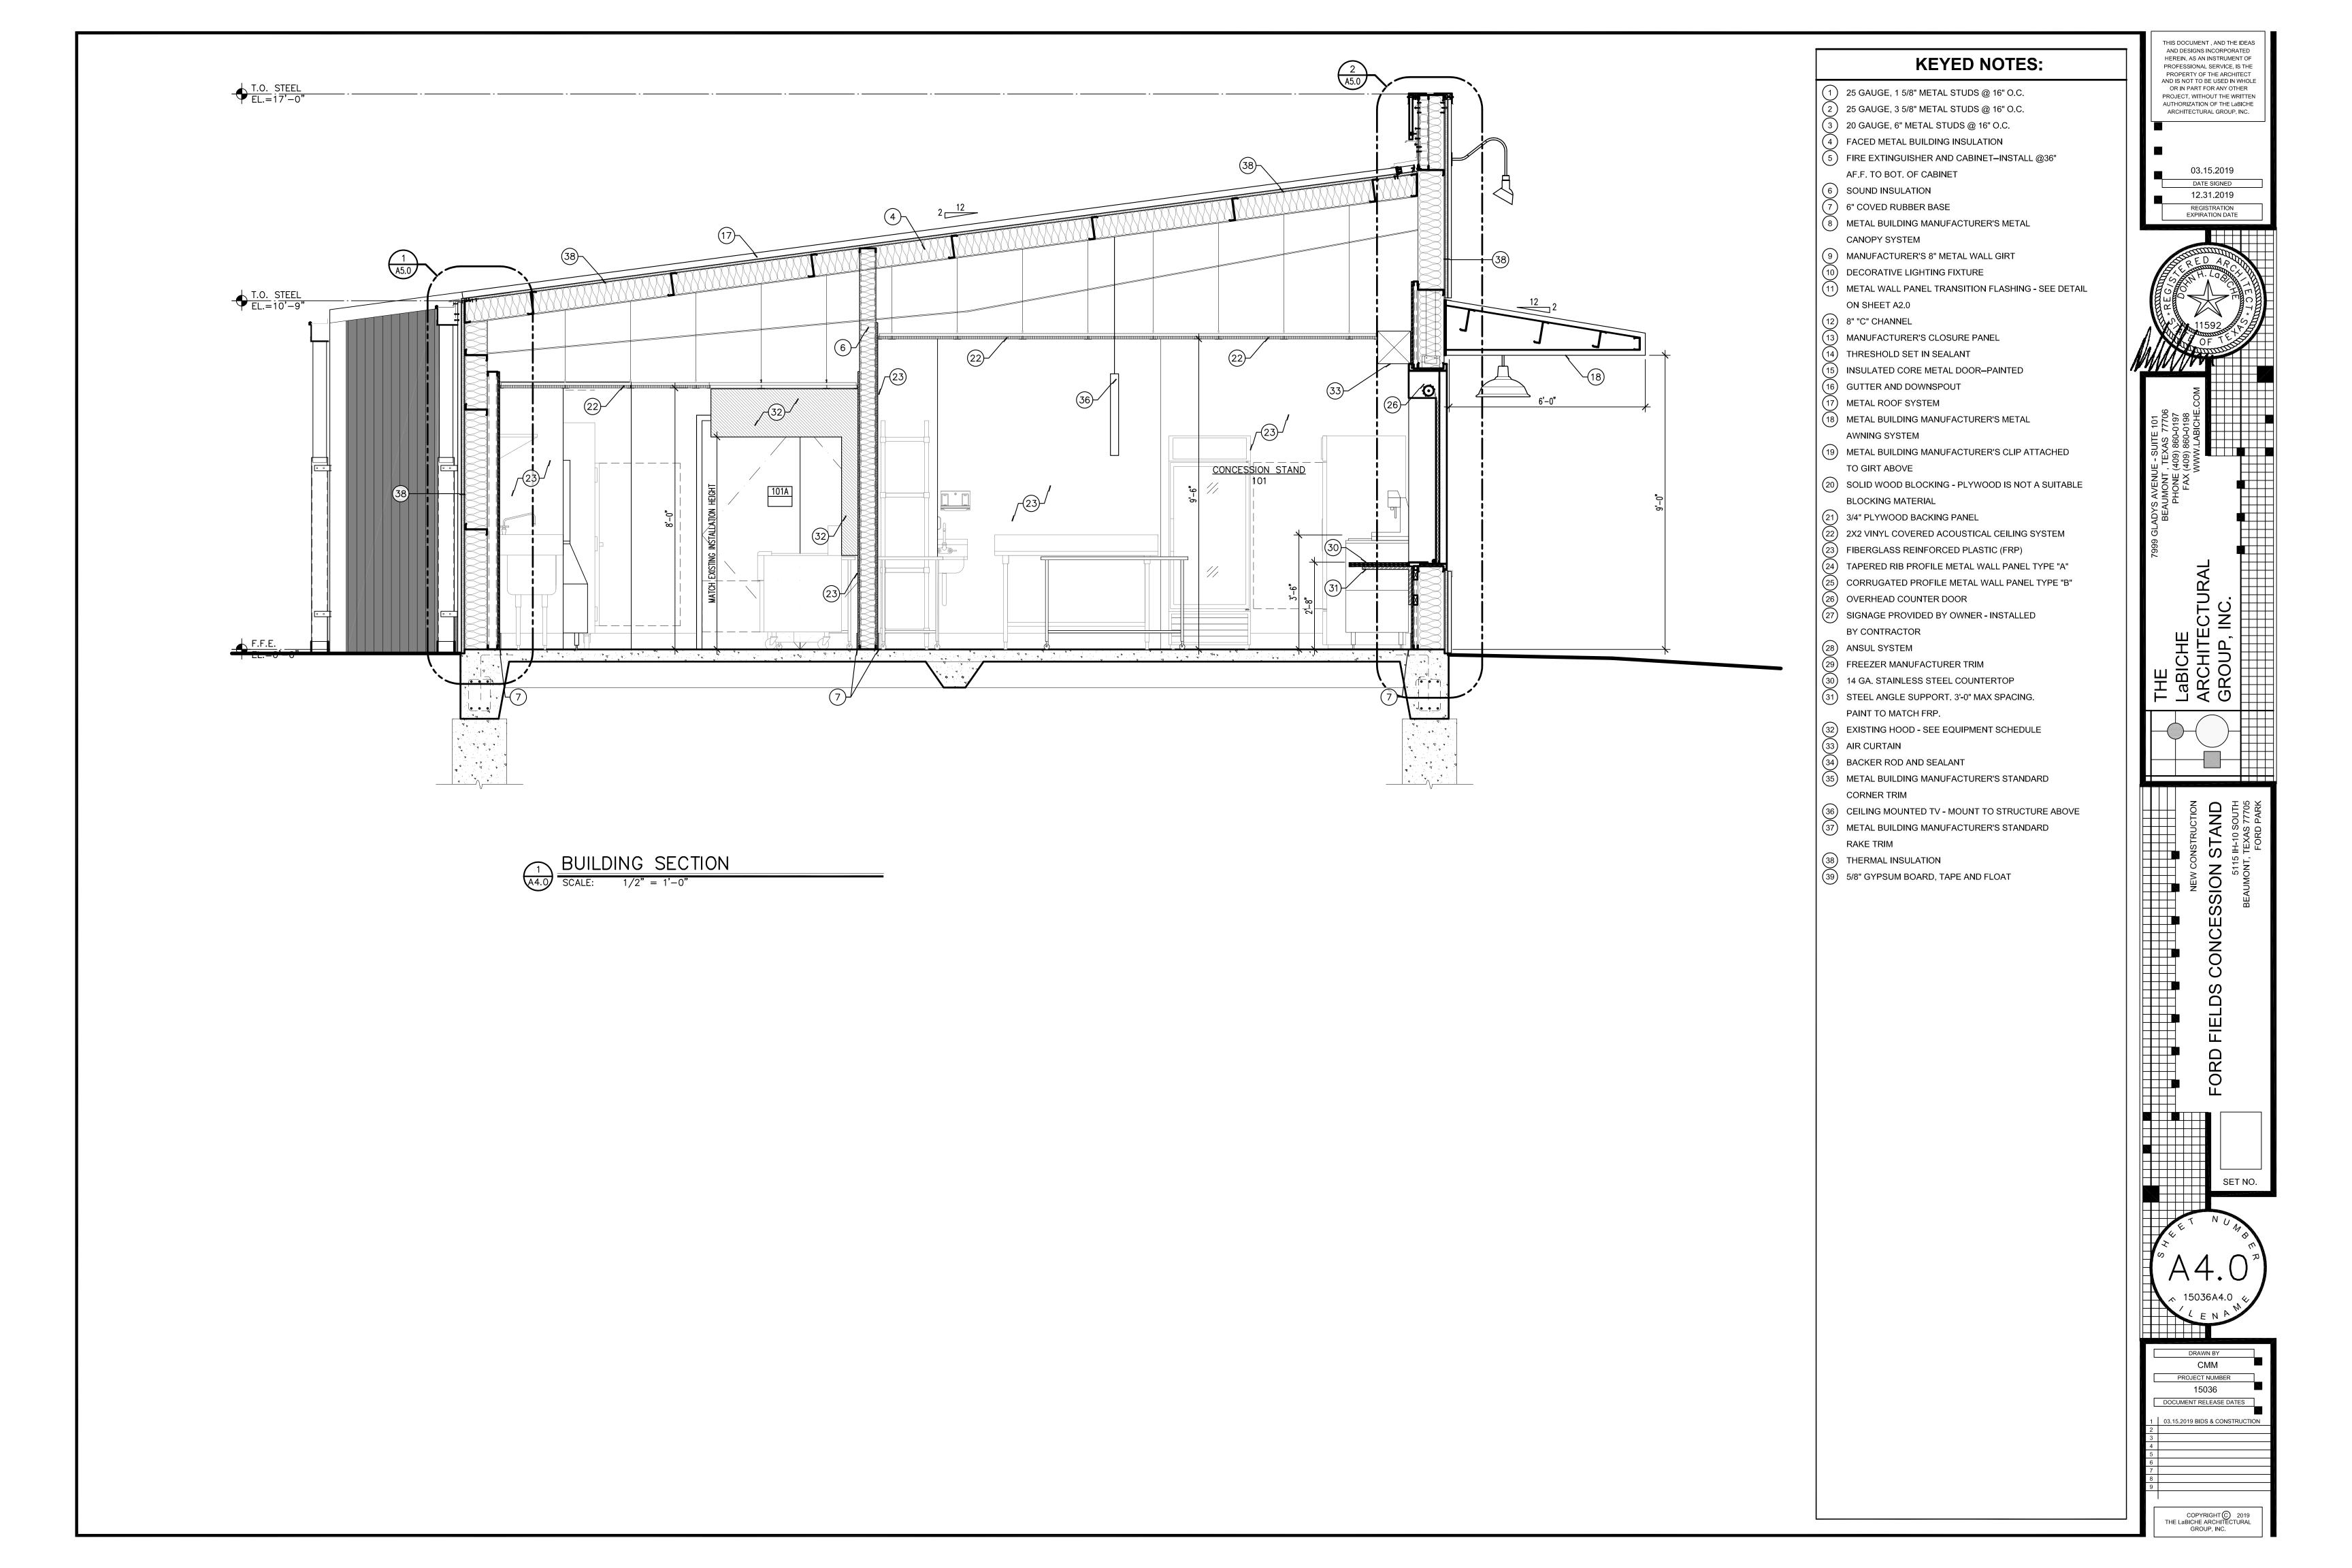

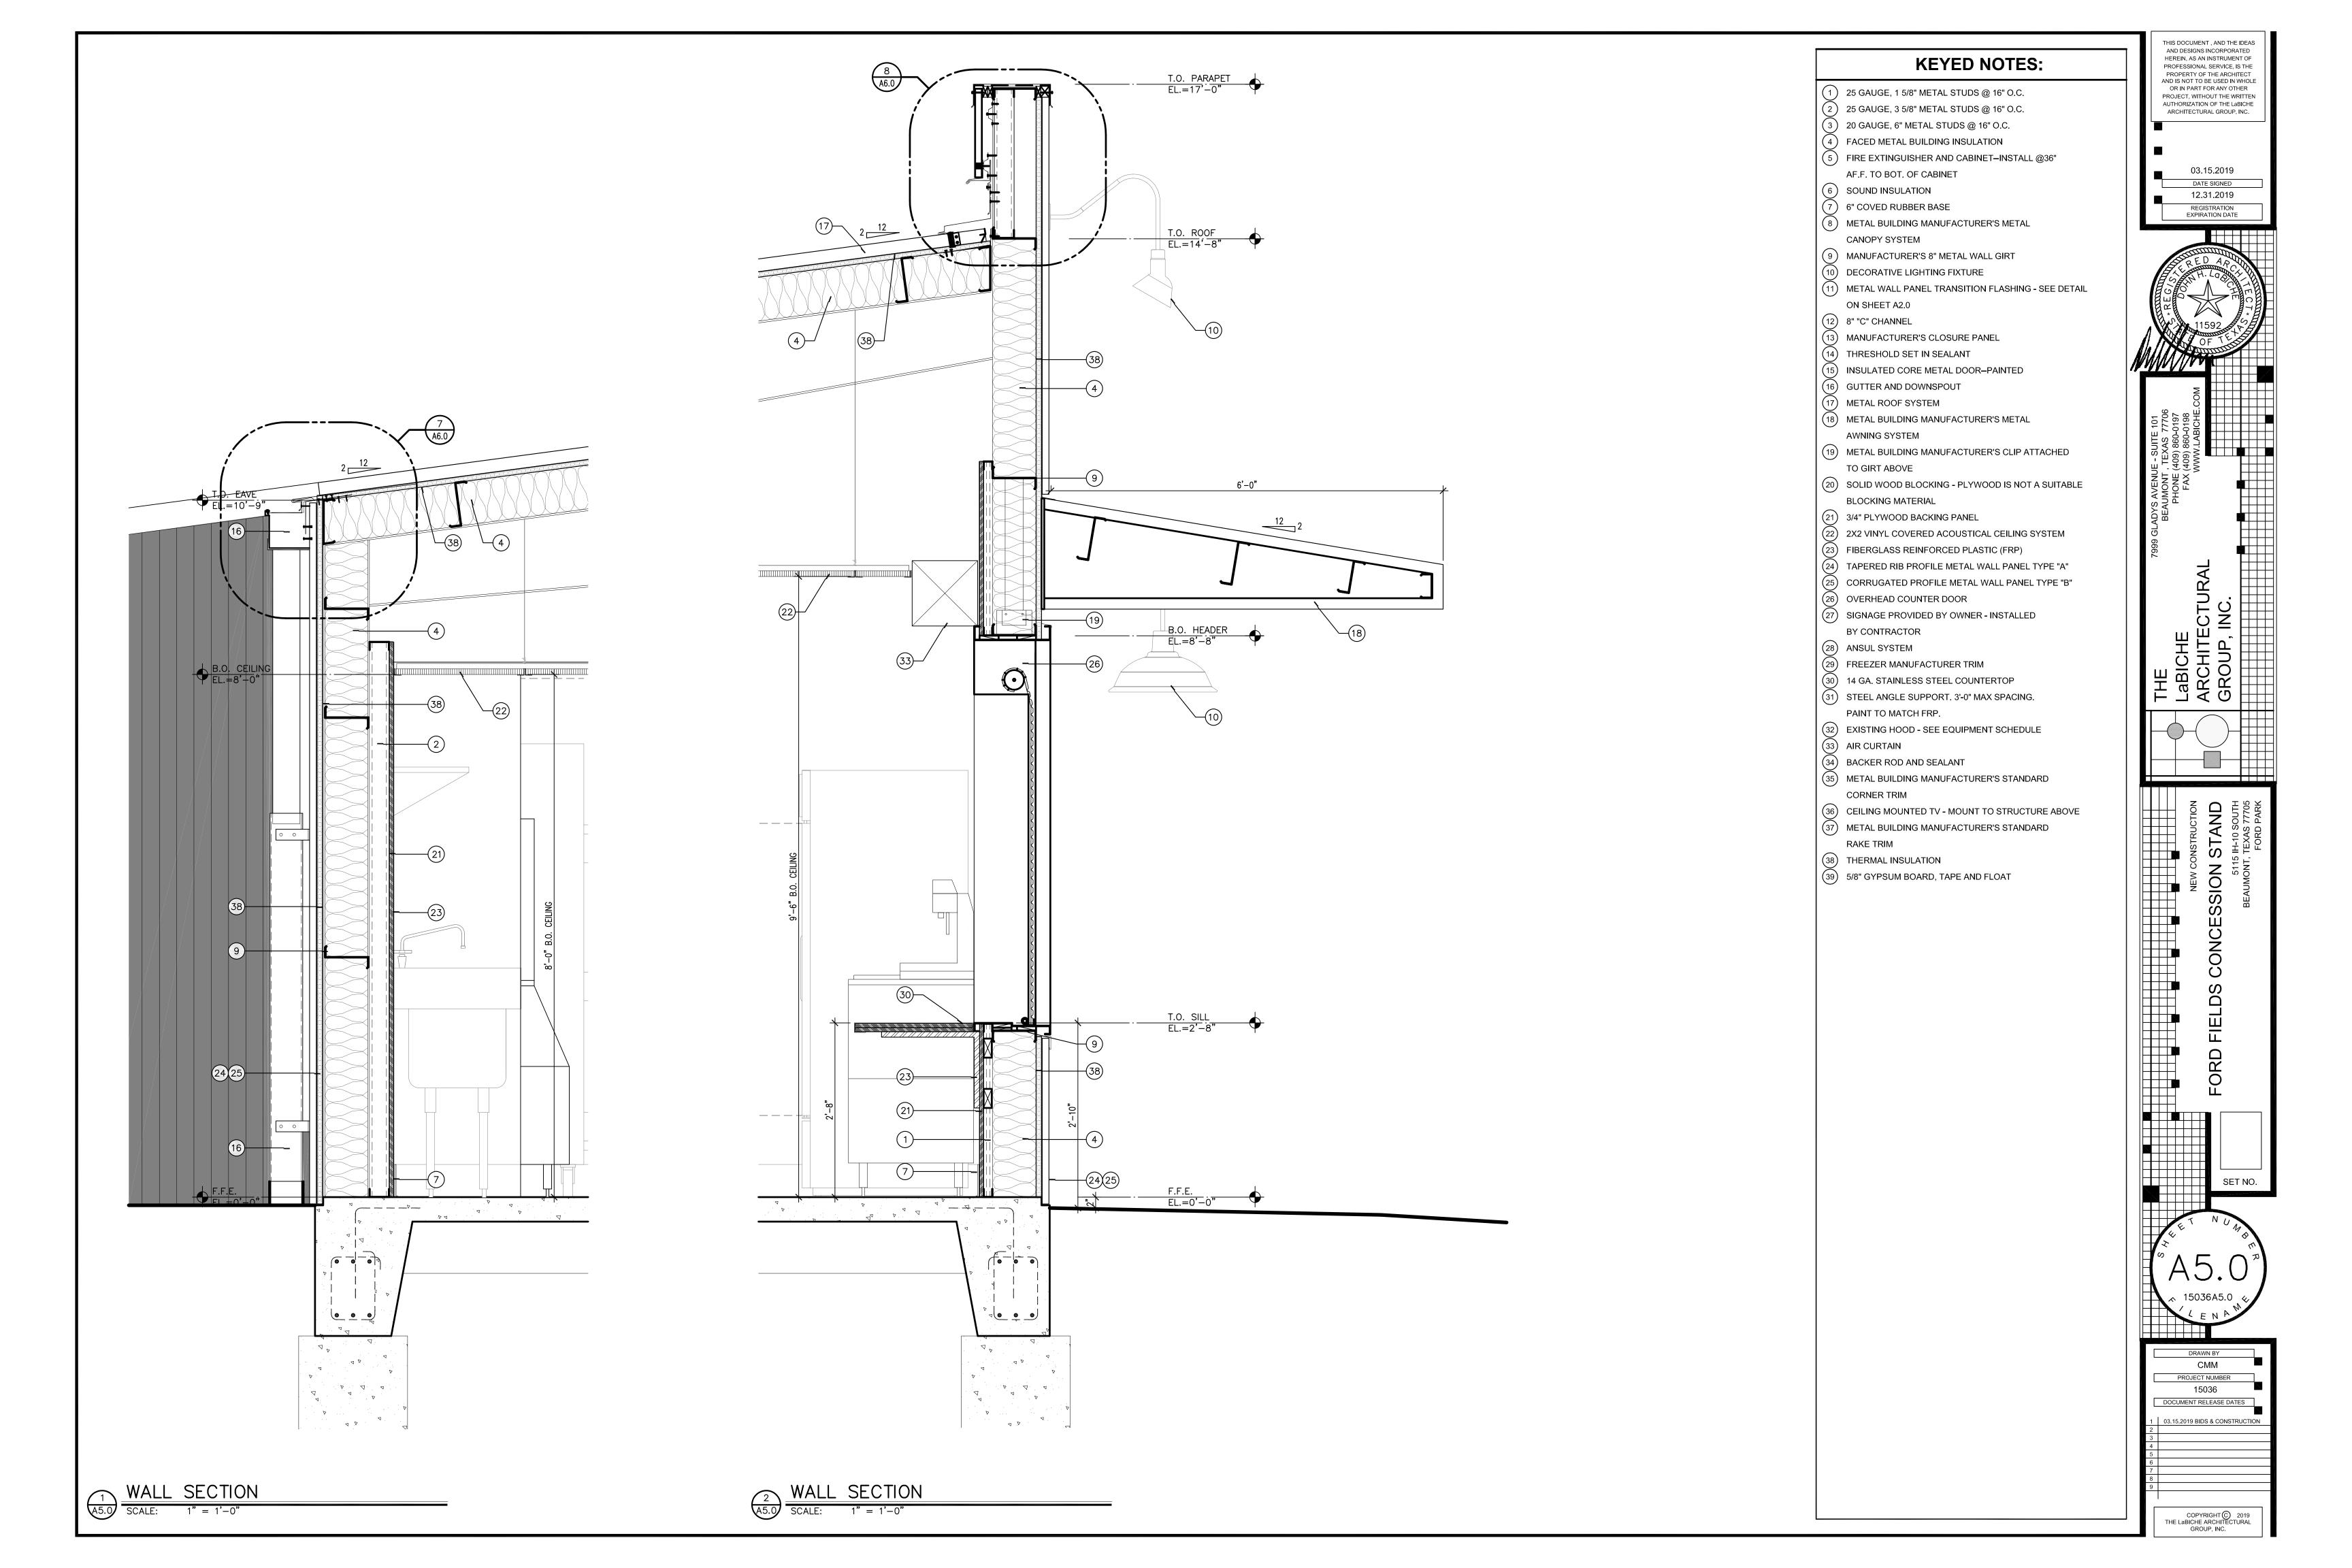

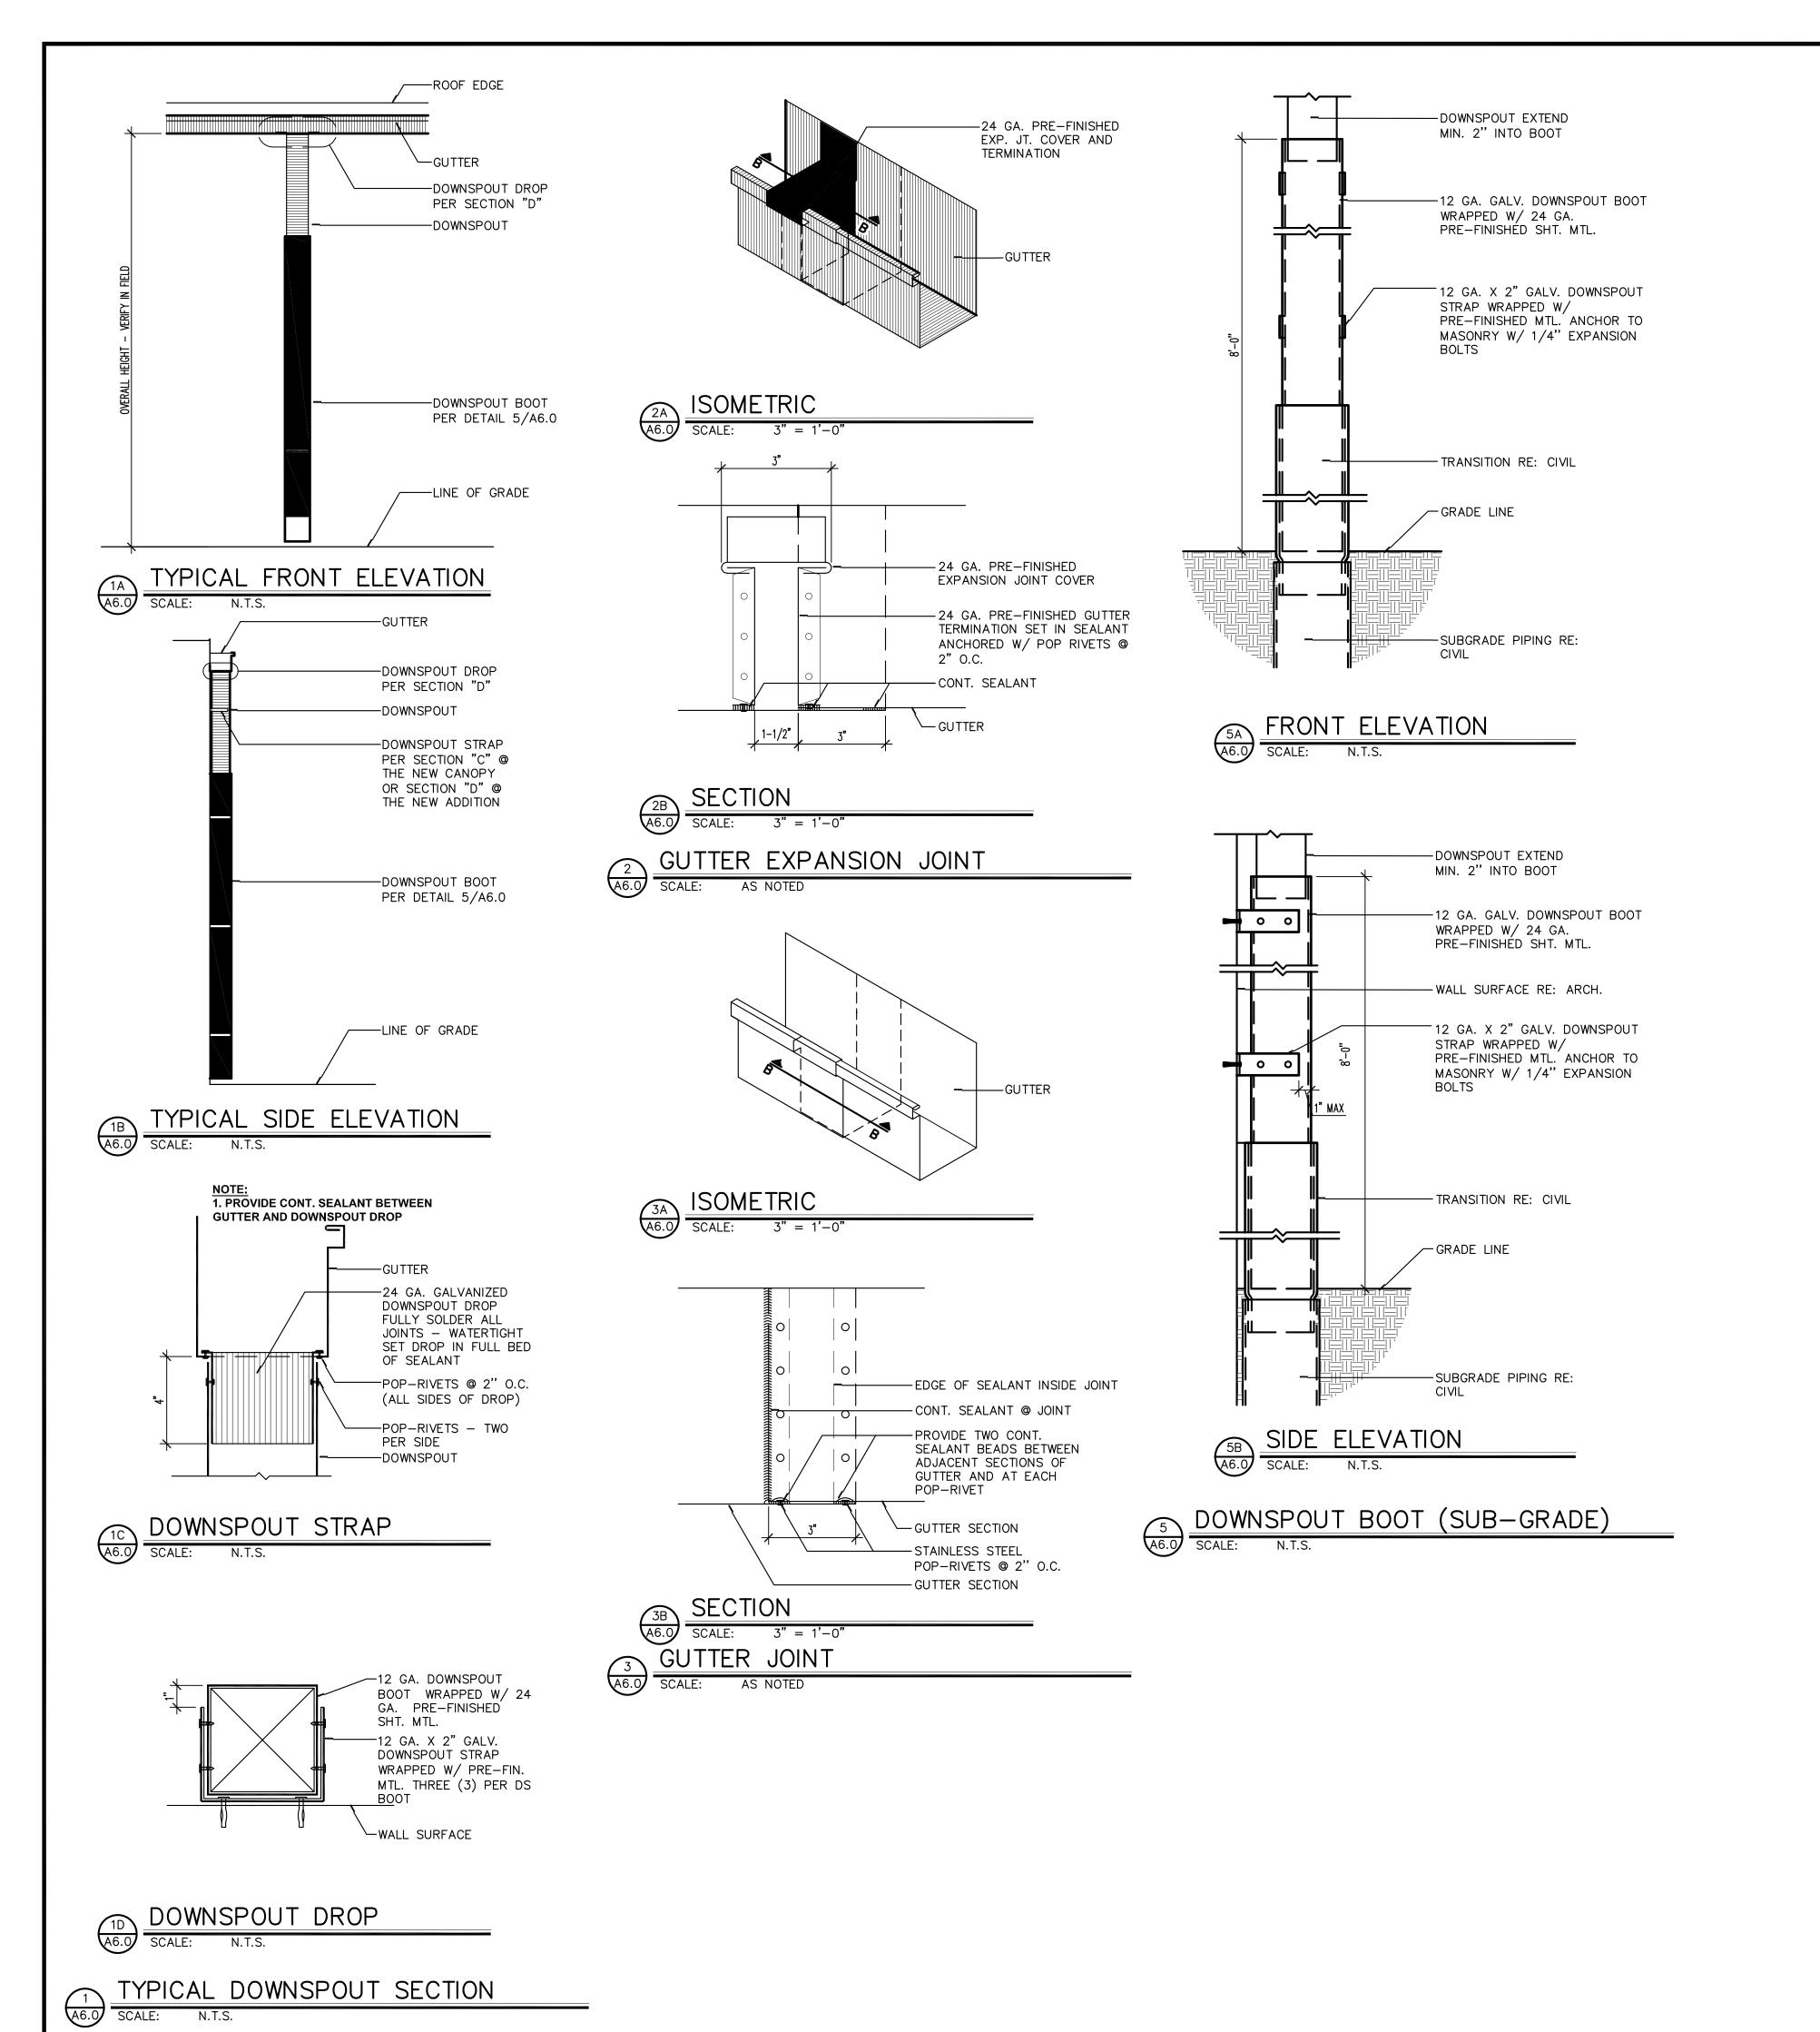

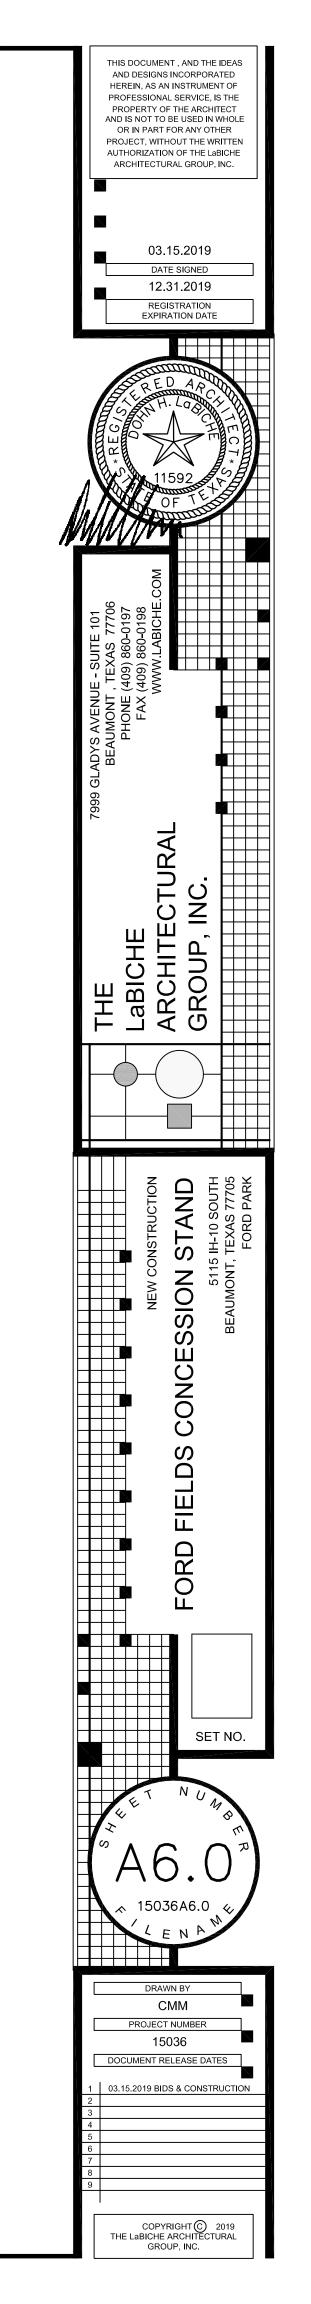

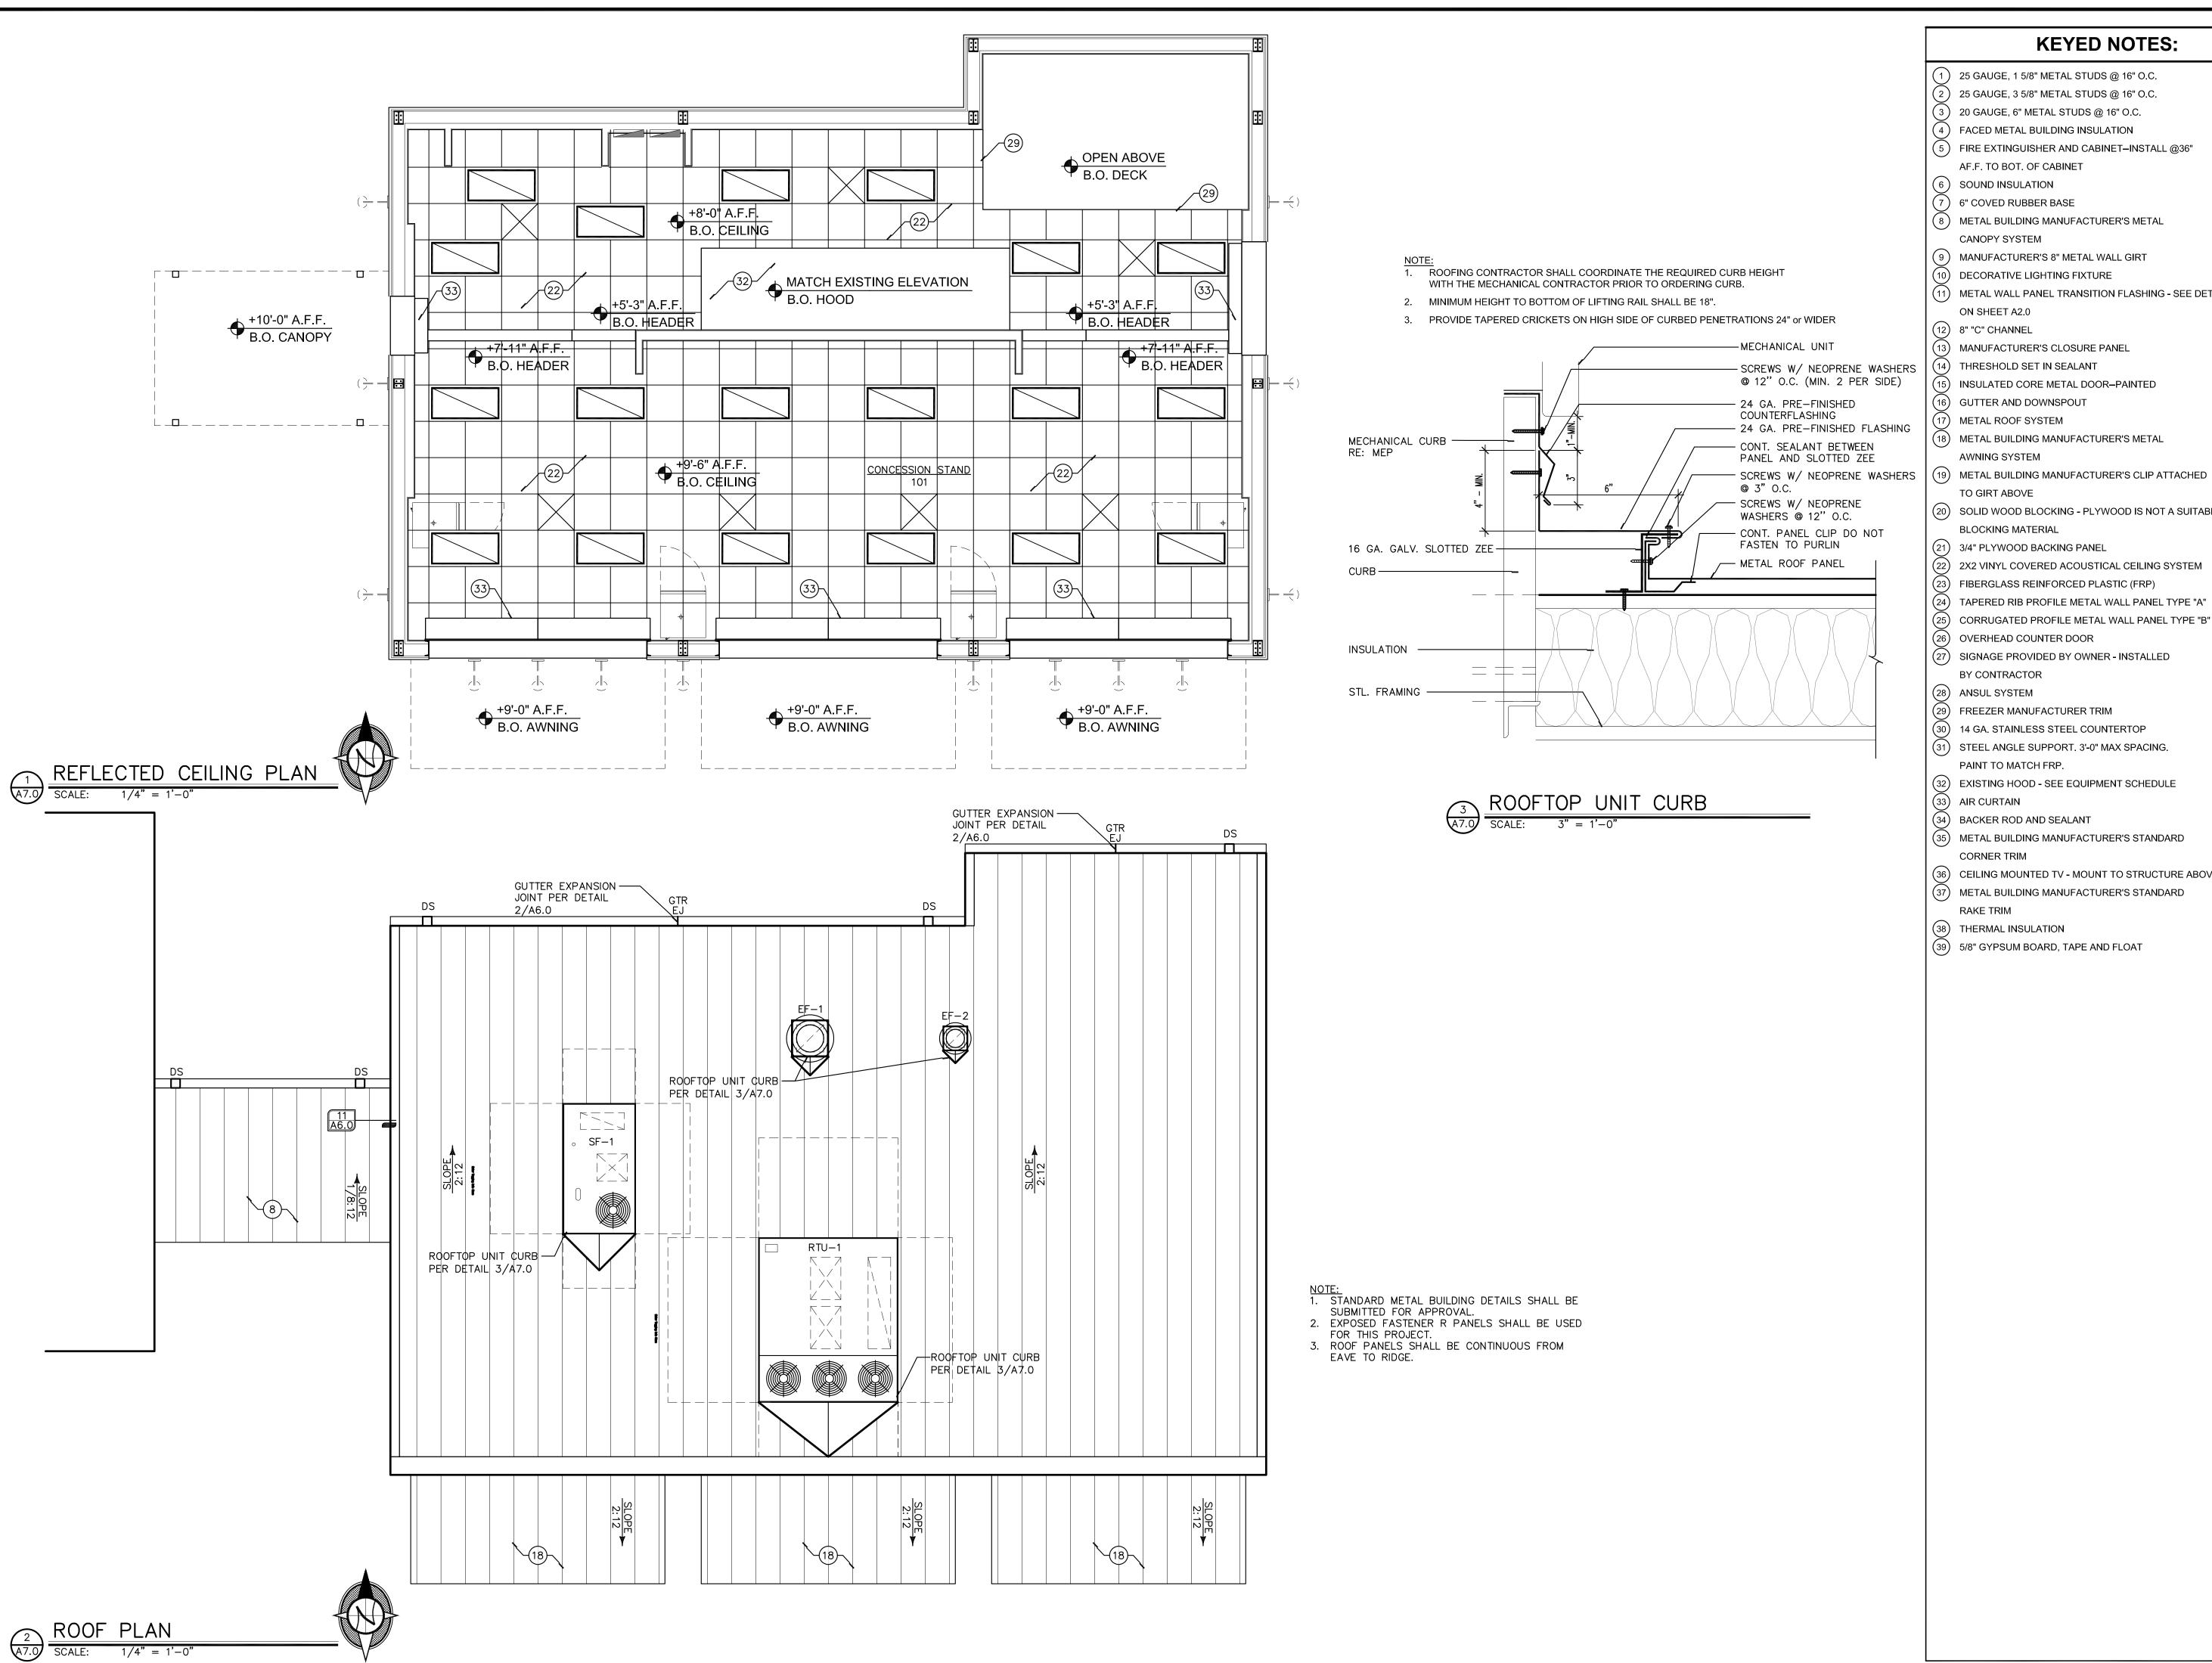

KEYED NOTES:

- (1) 25 GAUGE, 1 5/8" METAL STUDS @ 16" O.C.
- (2) 25 GAUGE, 3 5/8" METAL STUDS @ 16" O.C.
- (3) 20 GAUGE, 6" METAL STUDS @ 16" O.C.
- (4) FACED METAL BUILDING INSULATION
- (5) FIRE EXTINGUISHER AND CABINET-INSTALL @36" AF.F. TO BOT. OF CABINET
- (6) SOUND INSULATION
- (7) 6" COVED RUBBER BASE
- (8) METAL BUILDING MANUFACTURER'S METAL CANOPY SYSTEM
- (9) MANUFACTURER'S 8" METAL WALL GIRT
- 10) DECORATIVE LIGHTING FIXTURE
- (11) METAL WALL PANEL TRANSITION FLASHING SEE DETAIL ON SHEET A2.0
- (12) 8" "C" CHANNEL
- 13) MANUFACTURER'S CLOSURE PANEL
- (14) THRESHOLD SET IN SEALANT
- INSULATED CORE METAL DOOR-PAINTED
- 16) GUTTER AND DOWNSPOUT
- METAL ROOF SYSTEM
- (18) METAL BUILDING MANUFACTURER'S METAL
- TO GIRT ABOVE
- (20) SOLID WOOD BLOCKING PLYWOOD IS NOT A SUITABLE BLOCKING MATERIAL
- (21) 3/4" PLYWOOD BACKING PANEL
- (22) 2X2 VINYL COVERED ACOUSTICAL CEILING SYSTEM (23) FIBERGLASS REINFORCED PLASTIC (FRP)
- (24) TAPERED RIB PROFILE METAL WALL PANEL TYPE "A"
- (25) CORRUGATED PROFILE METAL WALL PANEL TYPE "B"
- (26) OVERHEAD COUNTER DOOR
- (27) SIGNAGE PROVIDED BY OWNER INSTALLED
- (28) ANSUL SYSTEM
- (29) FREEZER MANUFACTURER TRIM
- (30) 14 GA. STAINLESS STEEL COUNTERTOP
- (31) STEEL ANGLE SUPPORT. 3'-0" MAX SPACING. PAINT TO MATCH FRP.
- (32) EXISTING HOOD SEE EQUIPMENT SCHEDULE
- (34) BACKER ROD AND SEALANT
- (35) METAL BUILDING MANUFACTURER'S STANDARD
- (36) CEILING MOUNTED TV MOUNT TO STRUCTURE ABOVE
- (37) METAL BUILDING MANUFACTURER'S STANDARD RAKE TRIM
- (38) THERMAL INSULATION
- (39) 5/8" GYPSUM BOARD, TAPE AND FLOAT

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN AUTHORIZATION OF THE LaBICHE ARCHITECTURAL GROUP, INC. 03.15.2019 DATE SIGNED 12.31.2019 REGISTRATION EXPIRATION DATE

NEW CONSTRUCTIO

S CONCESSION STANE

5115 IH-10 SOUTI


BEAUMONT, TEXAS 7770

FIEL

CMM PROJECT NUMBER 15036 DOCUMENT RELEASE DATES

03.15.2019 BIDS & CONSTRUCTION

COPYRIGHT © 2019 THE LABICHE ARCHITECTURAL GROUP, INC.

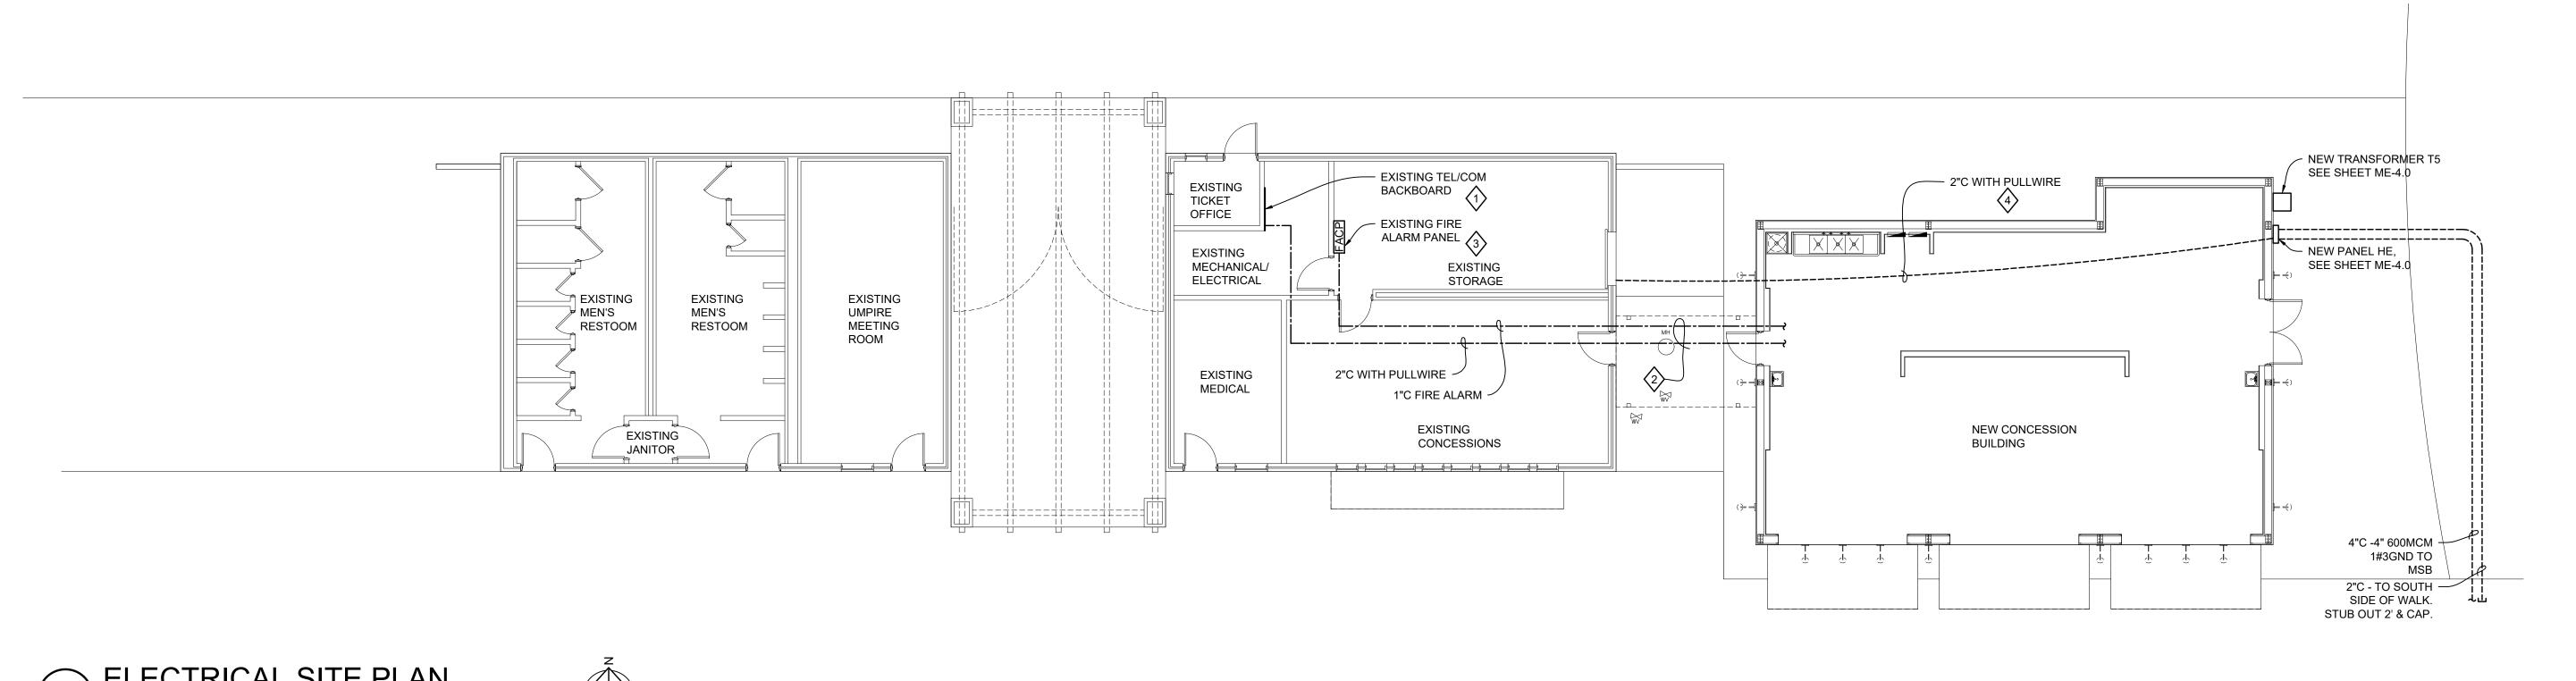

1/2" x 6'-0" LONG FLEXIBLE METAL RACEWAY WITH CONDUCTORS REQUIRED FOR SWITCHED CONDUCTORS, UNSWITCHED CONDUCTORS, NEUTRAL, AND GROUND.

UNDERGROUND WIRING.

CONCEALED WIRING. EXPOSED WIRING.

HOME RUN TO PANEL AND CIRCUIT INDICATED.

20A 125V DUPLEX SPECIFICATION GRADE RECEPTACLE WITH THERMOPLASTIC HIGH-IMPACT RESISTANT WALL PLATE. MOUNT BOTTOM AT 16" A.F.F. UNLESS OTHERWISE NOTED.

> CT = COUNTERTOP MOUNTED HORIZONTALLY UC = UNDER COUNTER

GFCI = GROUND FAULT CIRCUIT INTERRUPTER, FEED THRU TYPE WP = WEATHER PROOF COVER

2 EA. 20A 125V DUPLEX SPECIFICATION GRADE RECEPTACLE WITH THERMOPLASTIC HIGH-IMPACT RESISTANT WALL PLATE. MOUNT BOTTOM AT 16" A.F.F. UNLESS OTHERWISE NOTED.

SPECIAL RECEPTACLE. SEE EQUIPMENT SCHEDULE FOR REQUIREMENTS. FIELD VERIFY EXACT EQUIPMENT REQUIREMENTS.

ALUMINUM TELEPOWER POLE WITH 2 EA. 20A 125V DUPLEX RECEPTACLES ON EACH SIDE AS INDICATED. VERIFY POLE HEIGHT WITH ROOM CEILING HEIGHT. RECEPTACLE HEIGHTS TO BE 42" TO BOTTOM RECEPTACLE.

20A 120/277 SPECIFICATION GRADE HUBBELL SERIES 1221 TOGGLE SWITCH WITH THERMOPLASTIC HIGH-IMPACT RESISTANT COVER PLATE TO MATCH RECEPT. COVER PLATE COLOR SELECTED BY ARCHITECT ON ROOM-BY-ROOM BASIS. MOUNT BOTTOM AT 44" A.F.F. UNLESS

- OTHERWISE NOTED. 2 = 2 POLE
- 3 = THREE WAY 4 = FOUR WAY

MANUAL MOTOR STARTER 30A WITHOUT OVERLOAD USED FOR MOTOR DISCONNECT.

4" SQ. SHEET METAL JUNCTION BOX DEPTH AS REQUIRED.

EQUIPMENT SINGLE OR THREE PHASE MOTOR HORSEPOWER NOTED.

HEAVY DUTY DISCONNECT SWITCH. FDS = FUSED

NFDS = NONFUSED EXIT LIGHT (SINGLE FACE) - SEE LIGHT FIXTURE SCHEDULE.

3/4"x10' COPPER CLAD GROUND ROD WITH TOP EXPOSED 6" ABOVE FINISHED GRADE.

3/4"x10' COPPER CLAD GROUND ROD IN QUAZITE #PC0608 WITH

#PC0608CA00 COVER MARKED "GROUND".

ADDRESSABLE FIRE ALARM CONTROL PANEL. (EXISTING) COMPUTER JUNCTION BOX 4" SQ. x 2-1/8" D. WITH 2 EACH 1"C CONDUIT STUB-UP INTO ACCESSIBLE CEILING SPACE 12" ABOVE CEILING UNLESS OTHERWISE NOTED. PROVIDE MATCHING COVER PLATE TO WIRING DEVICES WITH ORANGE DATA JACKS. MOUNT BOTTOM AT 15" A.F.F.

UNLESS OTHERWISE NOTED. W = 44" ABOVE FINISHED FLOOR

CT = COUNTERTOP UC = UNDER COUNTER

CABLE TV AND DATA JUNCTION BOX 4" SQ. x 2-1/8" D. WITH 1"C EACH CONDUIT STUB-UP INTO ASSESSABLE CEILING SPACE 12" ABOVE CEILING UNLESS OTHERWISE NOTED. WALL PLATE AND JACK TO MATCH WIRING DEVICES.

C = CEILING MOUNTED

ELECTRICAL LEGEND

EXISTING TELEPHONE/DATA BACKBOARD. RUN 2"C FROM BACKBOARD TO CEILING SPACE OF NEW BUILDING. PROVIDE PULLWIRE IN CONDUIT

 $\langle 2 \rangle$ RUN ON TOP OF CANOPY AND SEAL ENTRANCES AT EACH BUILDING.

A EXISTING FIRE ALARM PANEL. EXPAND SYSTEM TO COVER NEW

BUILDING. SEE SHEET E-4.2.

RUN 1 EACH 2"C SPARE TO OUTSIDE OF EXISTING BUILDING FROM PANEL HE STUB UP AND CAP FOR FUTURE.

KEY NOTES

1. THE SCOPE OF WORK FOR THIS PROJECT IS REPRESENTED THROUGHOUT THESE DRAWINGS. THE CONTRACTOR SHALL REVIEW THE ARCHITECTURAL, CIVIL, STRUCTURAL, PLUMBING, MECHANICAL, AND ELECTRICAL DRAWINGS FOR ITEMS OF WORK TO BE INCLUDED. THE CONTRACTOR SHALL OBTAIN CLARIFICATION FROM THE ARCHITECT PRIOR TO ANY ROUGH-IN. FAILURE TO OBTAIN CLARIFICATION SHALL NOT RELIEVE THE CONTRACTOR FROM PROVIDING THE NECESSARY SERVICES AT THE REQUIRED LOCATION AT NO ADDITIONAL COST TO THE OWNER.

2. ALL WORK SHALL BE IN ACCORDANCE WITH THE LATEST EDITION, OR THE EDITION ENFORCED BY THE JURISDICTION IN WHICH THE PROJECT IS CONSTRUCTIED, OF THE FOLLOWING CODES AND STANDARDS:

- THE NATIONAL ELECTRICAL CODE (NFPA 70)
- NATIONAL FIRE ALARM CODE (NFPA 72) LIFE SAFETY CODE (NFPA 101)
- THE INTERNATIONAL BUILDING CODE, THE INTERNATIONAL FIRE CODE.
- STATE AND LOCAL CODES AND ORDINANCES COMPLETE WITH ANY MODIFICATIONS TO THE ABOVE CODES.

INSPECTION SHALL BE FURNISHED TO THE ARCHITECT.

WHERE CONFLICT BETWEEN THE CODES AND CONSTRUCTION DOCUMENTS OCCURS, THE MORE STRINGENT REQUIREMENTS WILL BE ENFORCED. ALL REQUIRED INSPECTIONS SHALL BE PERFORMED BY THE AUTHORITY HAVING JURISDICTION AND PAID FOR BY THE CONTRACTOR CERTIFICATES OF

3. ALL EQUIPMENT NECESSARY FOR A COMPLETE AND OPERABLE ELECTRICAL SYSTEM SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. CONTRACTOR SHALL COORDINATE AND VERIFY THE REQUIREMENTS FOR THE CONCESSION EQUIPMENT, BEING FURNISHED UNDER THIS CONTRACT AND/OR FURNISHED AND INSTALLED BY OTHERS OUTSIDE OF THIS CONTRACT. NOTIFY ARCHITECT AND ENGINEER OF ANY DISCREPANCIES AFFECTING THE WORK.

4. APPLICATION AND INSTALLATION OF MATERIALS AND EQUIPMENT SHALL BE STRICTLY IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. SHOULD THERE BY ANY DIFFERENCE BETWEEN SUCH RECOMMENDATIONS AND THE REQUIREMENTS OF THE DRAWINGS, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF SUCH DIFFERENCES AND OBTAIN THE ARCHITECT'S INTERPRETATION PRIOR TO INSTALLATION. DIFFERENCES BROUGHT TO THE ARCHITECT'S ATTENTION AFTER INSTALLATION SHALL BE CORRECTED TO THE ARCHITECT'S INTERPRETATION BY THE CONTRACTOR, AT THE CONTRACTOR'S EXPENSE.

5. ALL TIE-IN LOCATIONS SHOWN ARE GENERAL LOCATIONS. CONTRACTOR SHALL ESTABLISH EXACT LOCATIONS IN FIELD PRIOR TO ANY ROUGH-IN.

GENERAL ELECTRICAL NOTES

ME-1.0 ELECTRICAL SITE PLAN


ME-2.0 PLUMBING PLAN ME-2.1 PLUMBING SCHEDULES AND DETAILS ME-2.2 PLUMBING RISERS


ME-3.0 MECHANICAL PLAN ME-3.1 MECHANICAL DETAILS

ME-3.2 MECHANICAL SCHEDULES ME-4.0 ELECTRICAL POWER AND EQUIPMENT PLANS ME-4.1 ELECTRICAL HVAC PLAN AND PANEL SCHEDULES


INDEX TO ME DRAWINGS
SCALE: NONE

ME-4.2 ELECTRICAL LIGHTING AND SPECIAL SYSTEM PLANS

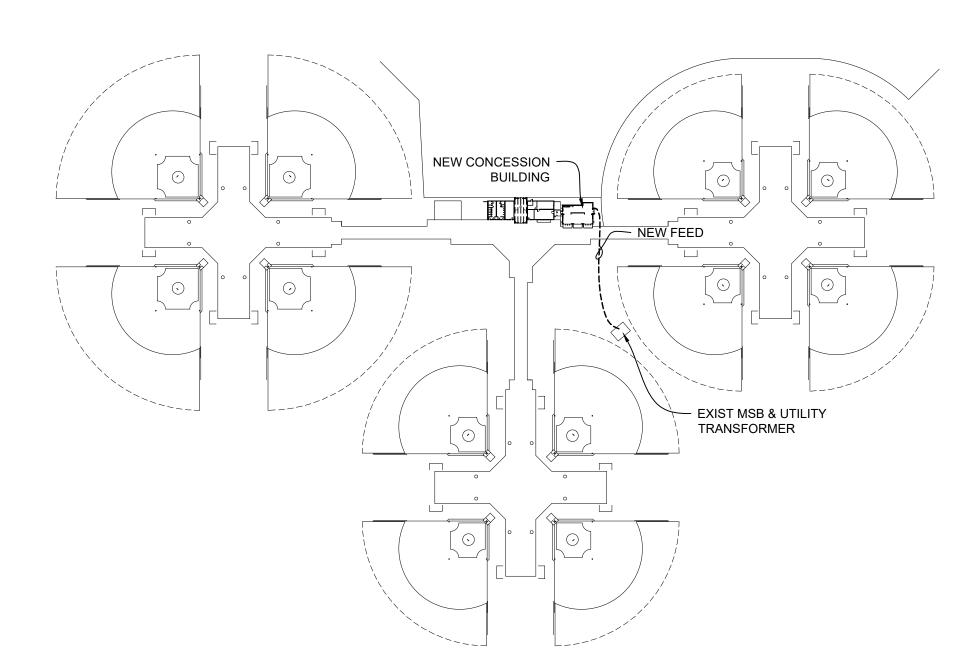


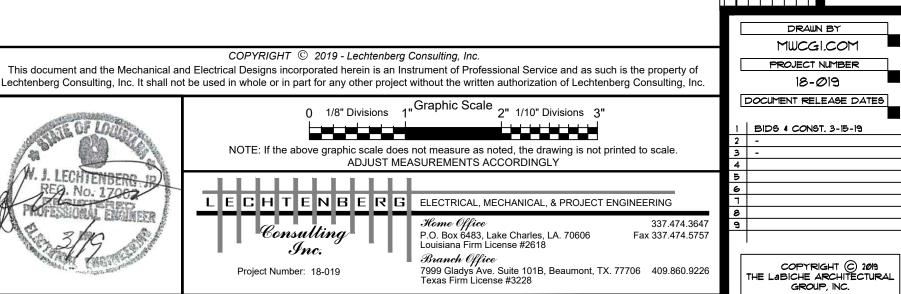


THIS DOCUMENT , AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOL OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN AUTHORIZATION OF THE LABICHE ARCHITECTURAL GROUP, INC. XXXXXXXX DATE SIGNED --.--2019 REGISTRATION EXPIRATION DATE

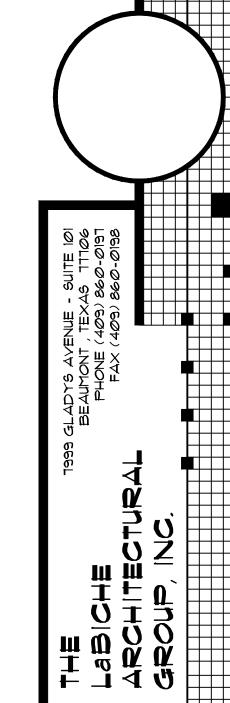


OCUMENT RELEASE DATES BIDS 4 CONST. 3-15-19

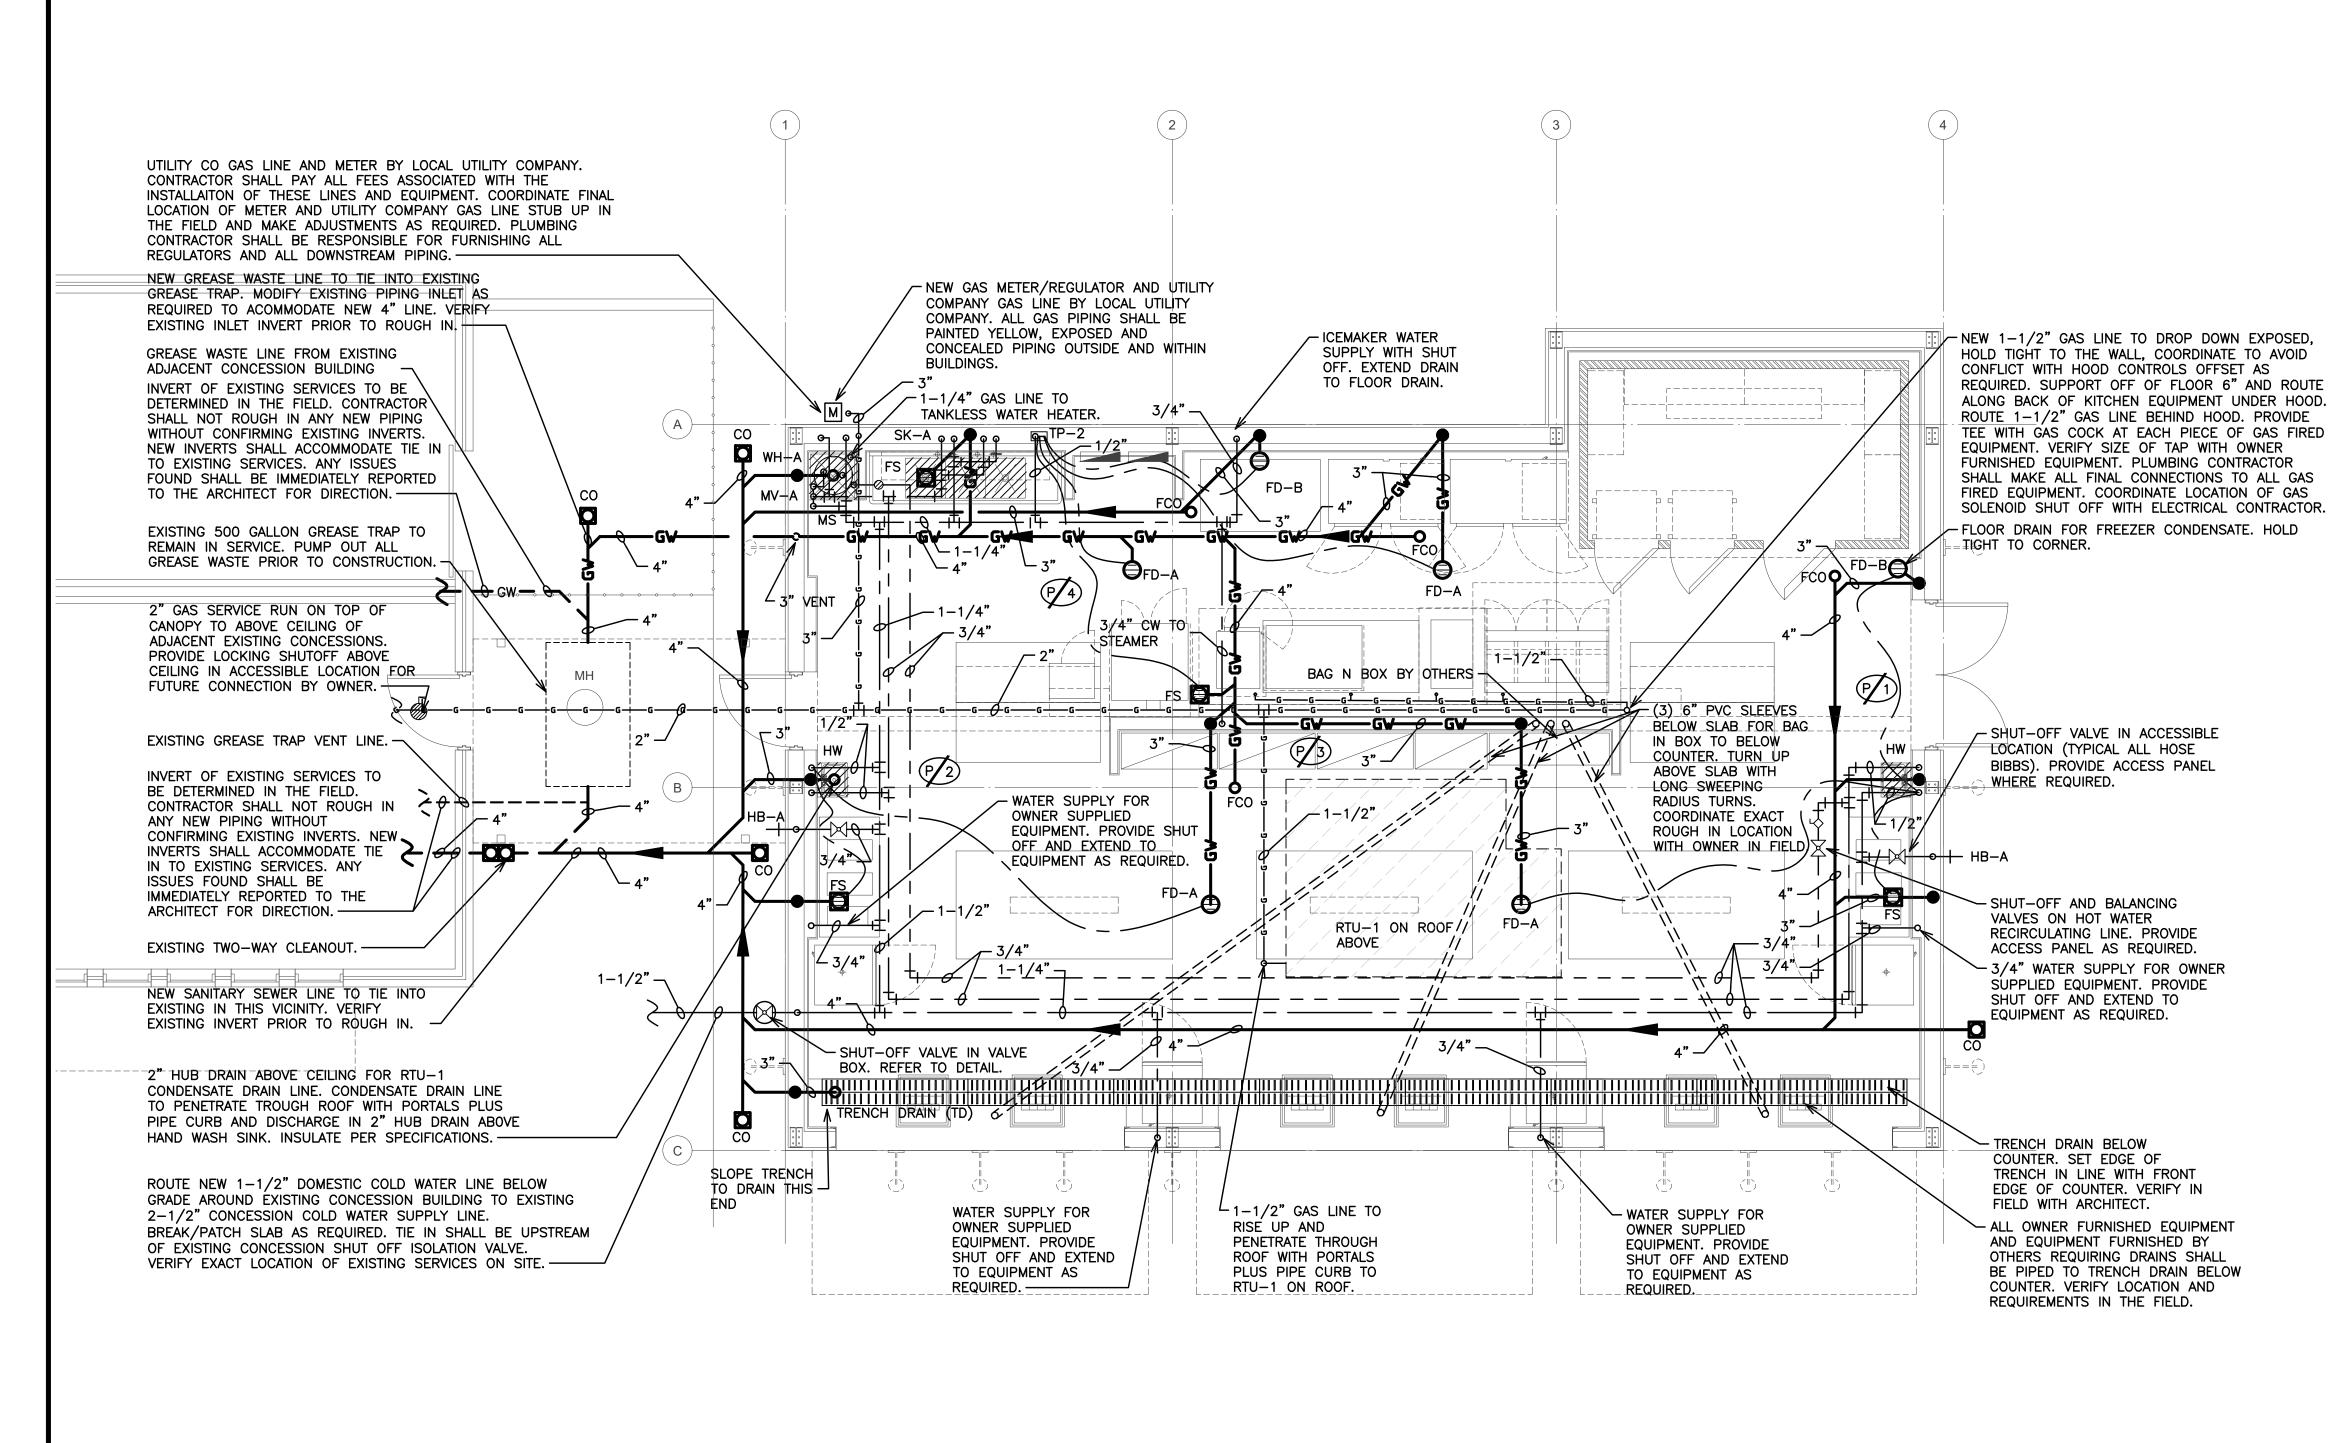

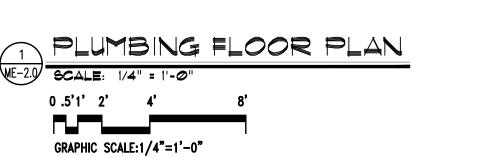

THE CONTRACTOR MAY SCALE THESE DRAWINGS. HOWEVER, THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL DIMENSIONS, PLAN SCALE, AND SITE CONDITIONS BEFORE BIDDING AND DURING CONSTRUCTION.

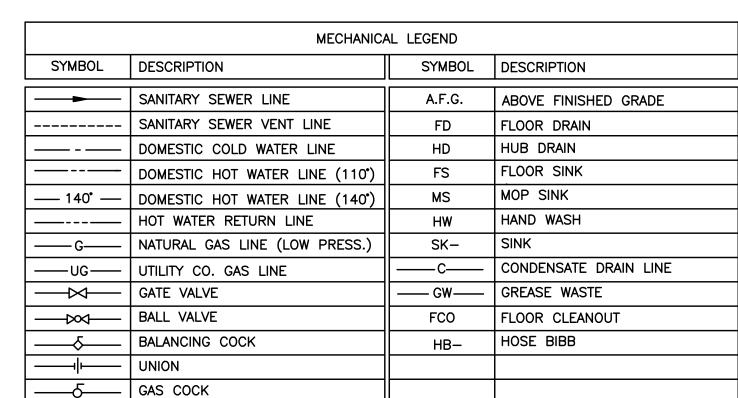

ABOVE FINISHED FLOOR

GENERAL PLUMBING NOTES:

THE FOLLOWING IS A BRIEF DESCRIPTION OF WORK SPECIFIC TO CERTAIN ASPECTS OF THIS PROJECT. THIS IS NOT INTENDED TO BE A COMPREHENSIVE SUMMARY OF WORK. PROSPECTIVE BIDDERS/CONTRACTORS SHALL REVIEW ALL CONSTRUCTION DRAWINGS, SPECIFICATIONS AND SITE CONDITIÓNS AND MAKE ALLOWANCES FOR ALL WORK INCLUDED HEREIN AND ANY ADDITIONAL WORK REQUIRED TO COMPLETE THIS PROJECT.

- . FURNISH AND INSTALL ALL EQUIPMENT/PLUMBING FIXTURES AS INDICATED BY THESE DRAWINGS. CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS AS REQUIRED.
- 2. CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS OF ALL EXISTING SERVICES IN FIELD PRIOR TO MAKING ROUGH-INS.
- 3. CONTRACTOR SHALL VERIFY THE EXISTING INVERTS OF ALL EXISTING SERVICES IN FIELD TO ASSURE THAT ALL PIPING IS RUN AT THE PROPER SLOPE.
- 4. THE ROUTING OF ALL PIPING SHALL BE COORDINATED WITH ALL THE OTHER TRADES TO AVOID POSSIBLE CONFLICTS.
- 5. ALL DOMESTIC WATER PIPING SHALL BE RUN ABOVE THE CEILING AND/OR CONCEALED IN WALLS UNLESS OTHERWISE NOTED.
- 6. CONTRACTOR SHALL COORDINATE SPACE REQUIREMENTS AND SERVICE CLEARANCES FOR ALL EQUIPMENT PRIOR TO SUBMITTING SHOP DRAWINGS.
- CONTRACTOR SHALL CONSOLIDATE VENTS TO MINIMIZE PENETRATIONS THROUGH ROOF. DO NOT LOCATE VENTS WITHIN 10FT OF HVAC FRESH AIR INTAKES, COORDINATE WITH MECHANICAL CONTRACTOR.
- 8. AT EACH FIXTURE OR GROUP OF FIXTURES (WITHIN SAME CHASE), FURNISH AND INSTALL A 12" HIGH AIR CHAMBER OF SAME SIZE AS BRANCH FEED LINE. PROVIDE "SHOCK ARRESTOR" AT ALL FIXTURES WITH QUICK CLOSING VALVES SUCH AS FLUSH VALVES, ETC.
- 9. PROVIDE CHROME PLATED BRASS ESCUTCHEONS WHERE PIPES PENETRATE FINISHED
- 10. CONTRACTOR SHALL SEAL ALL PENETRATIONS THROUGH EXTERIOR WALLS WEATHER TIGHT. SEALANT SHALL BE INSTALLED IN A NEAT AND WORKMANLIKE MANNER.
- 11. NO WATER OR DRAIN LINES MAY BE RUN ABOVE ELECTRICAL PANELS OR COMMUNICATION PANELS. COORDINATE WITH ELECTRICAL PLANS AND OFFSET PIPING IN THE FIELD AS REQUIRED.
- 12. PROVIDE REGULATOR AT EACH PIECE OF NEW GAS FIRED EQUIPMENT.


BRIEF PROJECT SCOPE:

RCE:190007

THE FOLLOWING IS A BRIEF DESCRIPTION OF WORK SPECIFIC TO CERTAIN ASPECTS OF THIS PROJECT. THIS IS NOT INTENDED TO BE A COMPREHENSIVE SUMMARY OF WORK. PROSPECTIVE BIDDERS/CONTRACTORS SHALL REVIEW ALL CONSTRUCTION DRAWINGS, SPECIFICATIONS AND SITE CONDITIONS AND MAKE ALLOWANCES FOR ALL WORK INCLUDED HEREIN AND ANY ADDITIONAL WORK REQUIRED TO COMPLETE THIS PROJECT.

- I. THE CONTRACTOR SHALL VISIT THE PROJECT SITE TO DETERMINE THE EXACT CONDITIONS WHICH WILL AFFECT THE SCOPE OF HIS WORK. THE CONTRACTOR SHALL INCLUDE ALL LABOR AND MATERIALS IN HIS WORK AS REQUIRED TO INSTALL WORK SHOWN ON THIS
- 2. THE CONTRACTOR SHALL REVIEW THE PLUMBING PLANS TO DETERMINE THE EXTENT OF THE WORK REQUIRED TO INSTALL THE SYSTEM(S) AS SHOWN ON THE PLANS. THE CONTRACTOR SHALL REALIZE THAT THE PLANS ARE DIAGRAMMATIC AND AS SUCH THE CONTRACTOR SHALL INSTALL ALL SYSTEMS COMPLETE AS RECOMMENDED BY THE MANUFACTURES OF PLUMBING FIXTURES AND EQUIPMENT. THE CONTRACTOR SHALL SUBMIT SHOP DRAWINGS AND MATERIAL/EQUIPMENT SUBMITTALS PER THE SPECIFICATIONS.
- 3. WHEN QUESTIONS ARISE DURING THE PROJECT THE CONTRACTOR SHALL SUBMIT A REQUEST FOR INFORMATION (RFI). THE CONTRACTORS SHOULD REALIZE THAT RFI'S CANNOT AND WILL NOT BE ANSWERED INSTANTLY DUE TO THE TIME OF ROUTING FROM THE POINT OF THE QUESTION TO THE POINT OF THE ANSWER AND BACK (MINIMUM OF 14 WORKING DAYS). THEREFORE RFI'S SHOULD BE SENT WHEN THE QUESTION IS NOT TIME SENSITIVE. TIME SENSITIVE QUESTIONS SHOULD BE HANDLED BY PHONE CALL FOR IMMEDIATE RESPONSE AND FOLLOWED WITH APPROPRIATE DOCUMENTATION OF THE QUESTION AND ANSWER GIVEN.
- 4. THE SUB-CONTRACTOR(S) FOR THE PLUMBING SYSTEMS SHALL SUBMIT ALL SHOP DRAWINGS PER THE SPECIFICATIONS IN DIVISION 22 GENERAL PROVISIONS SECTION. ALL SHOP DRAWINGS SHALL BE SUBMITTED WITHIN 30 DAYS OF THE GENERAL CONTRACTOR RECEIVING THE CONTRACTORS CONTRACT FROM THE OWNER. SUBMITTALS TAKE APPROXIMATE 30 WORKING DAYS FOR REVIEW AND RETURN BACK TO THE SUBMITTING SUB-CONTRACTOR . ON LONG LEAD TIME, EQUIPMENT SUBMITTAL, THE SUBMITTALS WILL BE EXPEDITED BY SPECIAL PROCEDURE TO BE DETERMINED AT TIME OF SUBMITTAL.
- 5. THE SUB-CONTRACTOR SHALL BE AWARE THAT PAINTING OF PIPE AND EQUIPMENT IS CALLED FOR IN THE PLANS AND IN THE SPECIFICATIONS. IT IS THE RESPONSIBILITY OF THE SUB-CONTRACTORS INSTALLING THE SYSTEMS ON THESE PLANS TO HAVE THE PAINTING PROVIDED. REFER TO SPECIFICATIONS.
- 6. THE SUB-CONTRACTORS FOR THE SYSTEMS ON THESE PLANS SHALL BE RESPONSIBLE FOR COORDINATION WITH ALL TRADES AND TO AVOID CONFLICT. COORDINATE ALL ELECTRICAL REQUIREMENTS PRIOR TO MAKING THE SHOP DRAWING SUBMITTALS. WHEN CONFLICTS OCCUR AND THE CONFLICT IS NOT RESOLVED BY THE GENERAL CONTRACTOR OR BETWEEN THE SUB-CONTRACTORS, THE ARCHITECT/ENGINEER SHALL ADVISE ON THE RESOLUTION OF THE CONFLICT WITHOUT ADDITIONAL COST TO THE OWNER. CONFLICTS ARE AVOIDED BY PROPER COORDINATION OF WORK.



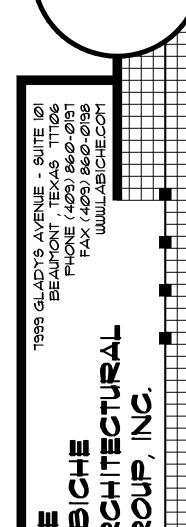

₹ 0 ₹ **8** ₹

DRAWN BY

ABS

15036


COPYRIGHT © 2019 HE LABICHE ARCHITECTURAL GROUP, INC.

COPYRIGHT © 2019 - Lechtenberg Consulting, Inc. This document and the Mechanical and Electrical Designs incorporated herein is an Instrument of Professional Service and as such is the property of Lechtenberg Consulting, Inc. It shall not be used in whole or in part for any other project without the written authorization of Lechtenberg Consulting, Inc. PROJECT NUMBER 1/8" Divisions 1" Graphic Scale 2" 1/10" Divisions DOCUMENT RELEASE DATES NOTE: If the above graphic scale does not measure as noted, the drawing is not printed to scale. BIDS & CONSTRUCTION - 3/15/ ADJUST MEASUREMENTS ACCORDINGLY ANDREA MANCEAUX L E C H T E N B E R G ELECTRICAL, MECHANICAL, & PROJECT ENGINEERING Consultina P.O. Box 6483, Lake Charles, LA. 70606 Fax 337.474.5757 Louisiana Firm License #2618 Branch Office 7999 Gladys Ave. Suite 101B, Beaumont, TX. 77706 409.860.9226 Texas Firm License #3228 Project Number: 18-019


ME-2.0 2019 8:

NOTES:


- 1. INSULATE ALL EXPOSED P—TRAPS AND ANGLE SUPPLIES ON HANDICAPPED LAVATORIES AND SINKS WITH TRUEBRO HANDI LAV—GUARD OR EQUAL.
- 2. PROVIDE AND INSTALL PISTON TYPE WATER HAMMER ARRESTORS AT ALL DOMESTIC WATER STUB-OUTS.
- 3. PROVIDE AND INSTALL 6" DEEP SEAL P-TRAPS FOR ALL FLOOR DRAINS, HUB DRAINS AND FLOOR SINKS,
- 4. ALL PLUMBING FIXTURES THAT REQUIRE VACUUM BREAKERS SUCH AS SERVICE SINKS, HOSE BIBBS, AND/OR SPECIAL EQUIP. SHALL BE SO EQUIPPED. 5. ALL HANDICAPPED PLUMBING FIXTURES SHALL BE SET TO "ADA" HEIGHT REQUIREMENTS. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT HEIGHTS.
- 6. ALL WATER HEATERS WITH 200,000 BTUH INPUT OR GREATER SHALL HAVE AN "A.S.M.E." RATED TANK.
- 7. CONTRACTOR SHALL VERIFY THAT ALL WATER HEATERS SHALL FIT IN THE SPACE PROVIDED AND THAT THE MANUF. RECOMMENDED SERVICE CLEARANCES ARE MAINTAINED.
- 8. PLUMBING CONTRACTOR SHALL CONFIRM ALL WATER AND DRAIN REQUIREMENTS FOR OWNER FURNISHED EQUIPMENT PRIOR TO ROUGH IN. EXTEND SERVICES AS REQUIRED.

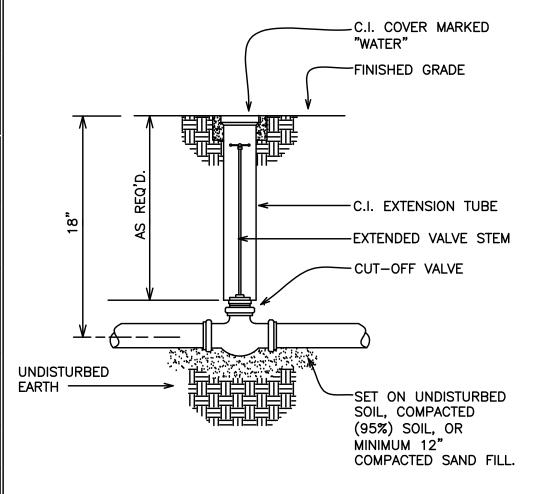

VALVE BOX DETAIL

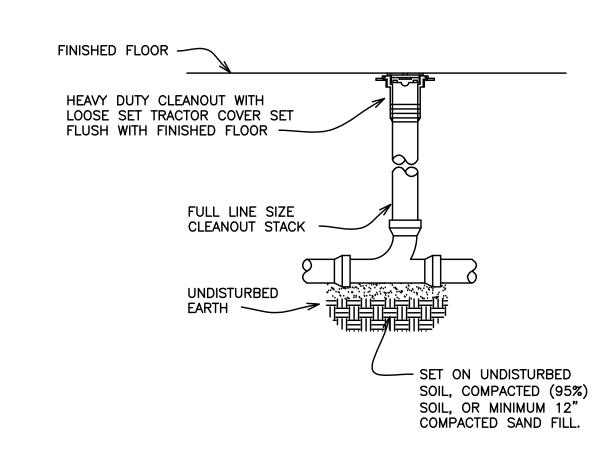

FLOOR CLEANOUT DETAIL

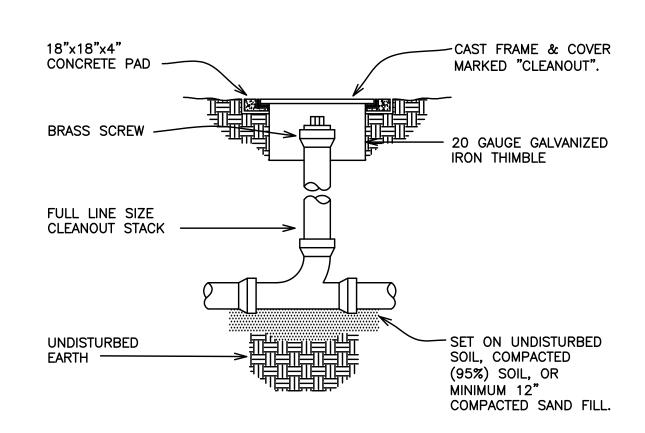

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOL

OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN

AUTHORIZATION OF THE LABICHE ARCHITECTURAL GROUP, INC.

DATE SIGNED

12.31.2019

REGISTRATION


EXPIRATION DATE

DRAWN BY

PROJECT NUMBER 15036


ABS

OUTSIDE CLEANOUT DETAIL

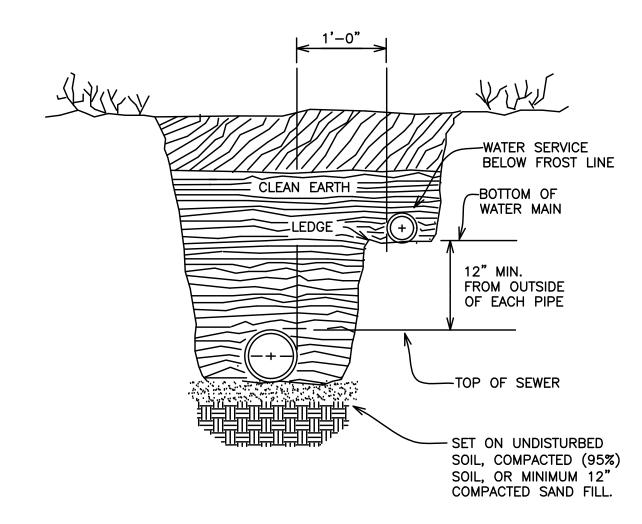


PIPE TRENCH DETAIL




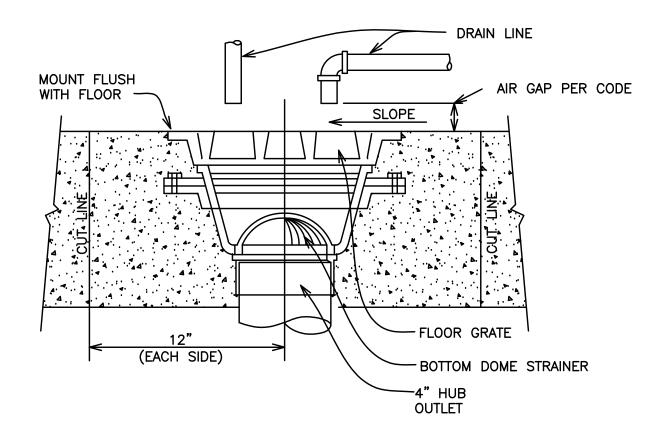

FLOOR SINK DETAIL

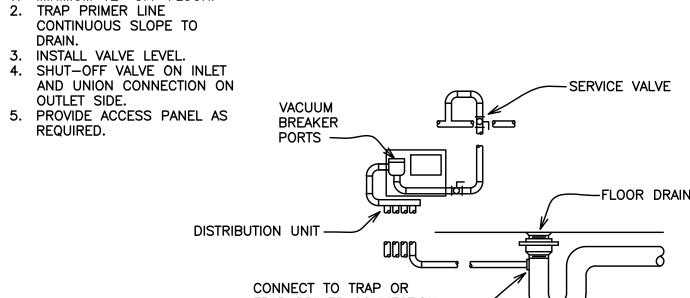


COLD WATER TRAP PRIMER DETAIL

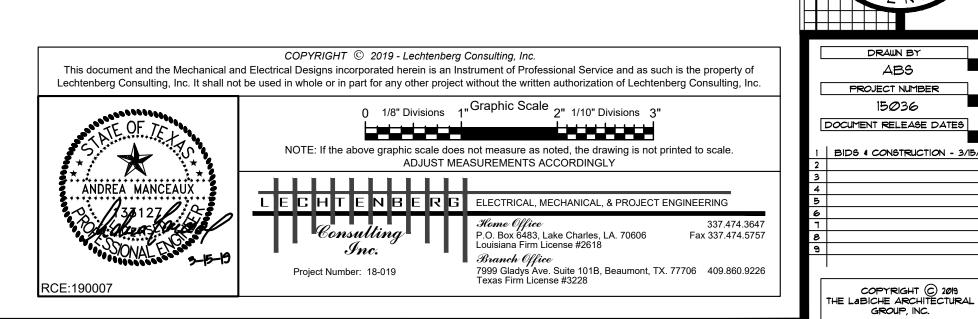

SCHEDULE 7:54:19 AM PLUMBING 13, 2019

. MINIMUM 12" OFF FLOOR. -FLOOR DRAIN TRAP PRIMER CONNECTION TO FLOOR DRAIN. —

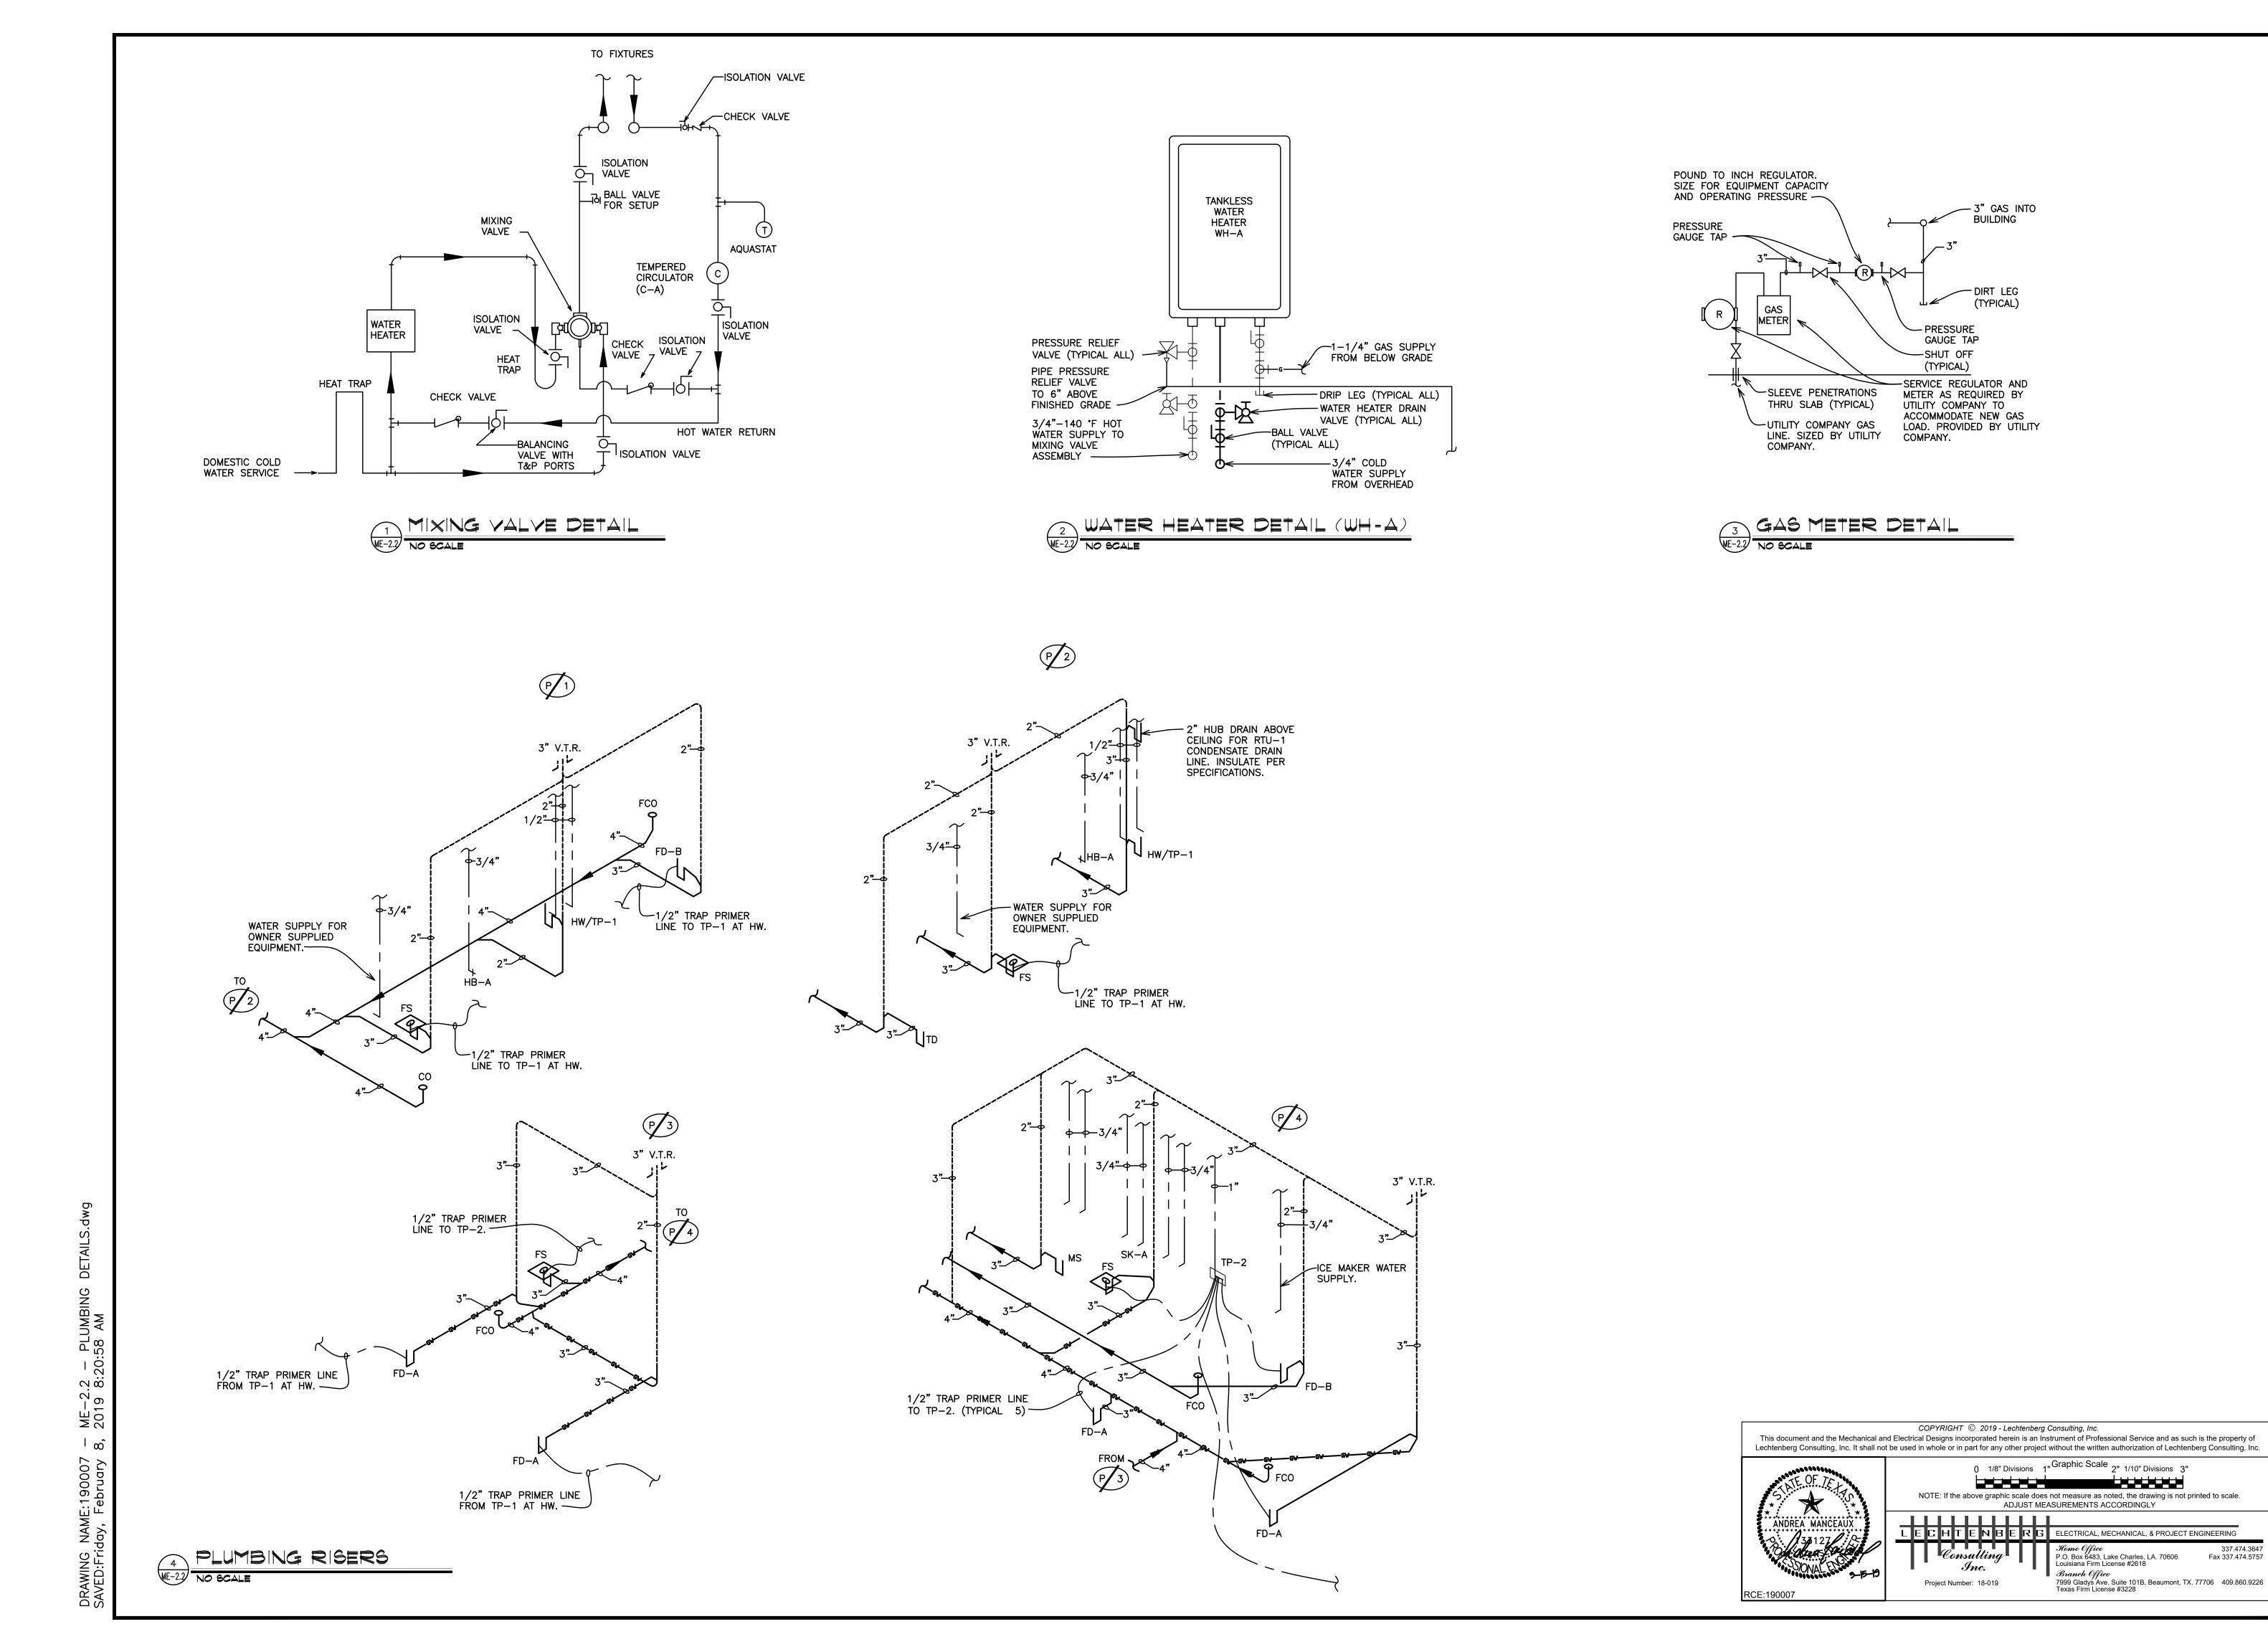

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN AUTHORIZATION OF THE LABICHE ARCHITECTURAL GROUP, INC. DATE SIGNED 12.31.2019 REGISTRATION EXPIRATION DATE DRAWN BY


ABS

PROJECT NUMBER 15036 DOCUMENT RELEASE DATES BIDS & CONSTRUCTION - 3/15/19

Fax 337.474.5757

COPYRIGHT © 2019 THE LABICHE ARCHITECTURAL GROUP, INC.





THE CONTRACTOR MAY SCALE THESE DRAWINGS. HOWEVER, THE CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL DIMENSIONS, PLAN SCALE, AND SITE CONDITIONS BEFORE BIDDING AND DURING CONSTRUCTION.



MECHANICAL GENERAL NOTES:

THE FOLLOWING IS A BRIEF DESCRIPTION OF WORK SPECIFIC TO CERTAIN ASPECTS OF THIS PROJECT. THIS IS NOT INTENDED TO BE A COMPREHENSIVE SUMMARY OF WORK. PROSPECTIVE BIDDERS/CONTRACTORS SHALL REVIEW ALL CONSTRUCTION DRAWINGS, SPECIFICATIONS AND SITE CONDITIONS AND MAKE ALLOWANCES FOR ALL WORK INCLUDED HEREIN AND ANY ADDITIONAL WORK REQUIRED TO COMPLETE THIS PROJECT. MEANS AND METHODS FOR THE PROPER INSTALLATION OF THIS WORK IS STRICTLY THE RESPONSIBILITY OF THE GENERAL CONTRACTOR AND HIS SUB-CONTRACTORS.

- 1. MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE ROUTING OF ALL DUCTWORK WITH THE STRUCTURE AND OTHER TRADES AS CONDITIONS ALLOW. RE-ROUTE DUCTWORK AS NECESSARY TO AVOID CONFLICT. TRANSITION UP/DOWN TO AVOID OTHER TRADES AS NECESSARY.
- 2. INSTALL AT EACH DUCT TAKEOFF AN ADJUSTABLE VOLUME DAMPER IN AN ACCESSIBLE LOCATION.
- 3. CONTRACTOR SHALL COORDINATE SPACE REQUIREMENTS AND SERVICE CLEARANCES FOR ALL EQUIPMENT PRIOR TO SUBMITTING SHOP DRAWINGS.
- 4. MECHANICAL CONTRACTOR SHALL PROCURE THE SERVICES OF AN INDEPENDENT AABC, TABB OR NEBB CERTIFIED TEST AND BALANCE AGENCY. TAB AGENCY SHALL PERFORM AN INITIAL SMOKE / PRESSURE LEAK TEST ON ALL DUCTWORK ONCE ALL SHEETMETAL DUCTWORK HAS BEEN INSTALLED. A FINAL BALANCE REPORT OF ALL HVAC SYSTEMS (INCLUDING SUPPLY/ RETURN TRAVERSES) AND EXHAUST FANS SHALL BE PROVIDED TO ARCHITECT/ ENGINEER UPON COMPLETION OF PROJECT. ALL REPORTS SHALL MEET AABC/NEBB STANDARDS. REFER TO SPECIFICATIONS FOR COMPLETE TEST AND BALANCE REQUIREMENTS.
- 5. COORDINATE FRESH AIR INLETS WITH EXHAUST OUTLETS AND PLUMBING VENTS TO MAINTAIN A 10'-0"
- 6. TRANSITION SUPPLY AND RETURN DUCTWORK TO FANS AND ROOFTOP UNITS WITH SMOOTH TRANSITIONS PER SMACNA STANDARDS AS NECESSARY. DUCTWORK CONNECTIONS TO EQUIPMENT SHALL BE MADE WITH FLEXIBLE CONNECTIONS.
- 7. ALL EXPOSED PIPING, DUCTS, HANGERS, SUPPORTS, ETC RUN THROUGH FINISHED SPACES OR EXPOSED AT EXTERIOR SHALL BE PRIMED AND PAINTED COLOR AS SELECTED BY ARCHITECT.
- 8. FURNISH AND INSTALL ACCESS PANELS WHERE VALVES, DAMPERS, EQUIPMENT, ETC. ARE CONCEALED OR INACCESSIBLE. ACCESS PANELS SHALL BE PRIMED AND PAINTED COLOR AS SELECTED BY ARCHITECT.
- 9. ALL CONCEALED HVAC DUCTWORK SHALL BE GALVANIZED STEEL, GAUGE PER SMACNA GUIDELINES. SNAP LOCK PIPE IS ACCEPTABLE. SEAL ALL SEAMS AND JOINTS WITH MASTIC. FLEX DUCT SHALL BE LIMITED TO 5FT, REFERS TO SPECIFICATIONS.
- 10. PROVIDE ONE SET OF CLEAN FILTERS AT COMPLETION OF PROJECT PRIOR TO TURNING OVER TO OWNER. CONSTRUCTION FILTERS SHALL BE USED DURING DURATION OF PROJECT TO PROTECT DUCTWORK AND EQUIPMENT. DO NOT OPERATE EQUIPMENT UNLESS BUILDING HAS BEEN THOROUGHLY CLEANED.
- 11. CONTRACTOR SHALL BE RESPONSIBLE FOR PREPARING SUBMITTAL PACKAGE (INCLUDING CHECK) FOR KITCHEN HOOD SUBMITTAL TO THE STATE FIRE MARSHAL. SUBMIT THROUGH PROFESSIONAL OF RECORD (MECHANICAL ENGINEER).
- 12. ALL KITCHEN HOOD EXHAUST DUCTWORK SHALL BE 16 GAUGE BLACK IRON WITH WELDED SEAMS AND JOINTS PER NFPA 96. INSULATE EXHAUST DUCT FOR 0" CLEARANCE TO COMBUSTIBLES.

13. COORDINATE ALL ROOF PENETRATIONS WITH ROOFING CONTRACTOR FOR A WATERTIGHT INSTALLATION.


14. DUCTWORK SHALL RUN WITHIN STRUCTURE WHERE THERE IS SPACE AVAILABLE WHEN CROSSING OVER OTHER DUCTWORK.


BRIEF PROJECT SCOPE:

THE FOLLOWING IS A BRIEF DESCRIPTION OF WORK SPECIFIC TO CERTAIN ASPECTS OF THIS PROJECT. THIS IS NOT INTENDED TO BE A COMPREHENSIVE SUMMARY OF WORK. PROSPECTIVE BIDDERS/CONTRACTORS SHALL REVIEW ALL CONSTRUCTION DRAWINGS, SPECIFICATIONS AND SITE CONDITIONS AND MAKE ALLOWANCES FOR ALL WORK INCLUDED HEREIN AND ANY ADDITIONAL WORK REQUIRED TO COMPLETE THIS

- 1. THE CONTRACTOR SHALL VISIT THE PROJECT SITE TO DETERMINE THE EXACT CONDITIONS WHICH WILL AFFECT THE SCOPE OF HIS WORK. THE CONTRACTOR SHALL INCLUDE ALL LABOR AND MATERIALS IN HIS WORK AS REQUIRED TO INSTALL WORK SHOWN ON THIS PLAN.
- THE CONTRACTOR SHALL REVIEW THE MECHANICAL PLANS (HVAC) TO DETERMINE THE EXTENT OF THE WORK REQUIRED TO INSTALL THE HVAC SYSTEM(S) AS SHOWN ON THE PLANS. THE CONTRACTOR SHALL REALIZE THESE PLANS ARE DIAGRAMMATIC AND AS SUCH INSTALL ALL SYSTEM(S) COMPLETE WHERE INDICATED ON THE PLANS. THE PLANS ATTEMPT TO SHOW ALL CONDITIONS FOR INSTALLATION, HOWEVER, THE CONTRACTOR SHALL ACCOMMODATE ALL CONDITIONS WHICH AFFECT THE INSTALLATION WHETHER OR NOT SHOWN. THE CONTRACTOR SHALL SUBMIT EQUIPMENT SUBMITTALS FOR REVIEW FOR ORDERING PURPOSES AND SHALL SUBMIT INSTALLATION SUBMITTAL DRAWINGS, FOR ALL EQUIPMENT SHOWING THE CONDITIONS OF INSTALLATION PER ALL DRAWINGS AND TRADE.
- 3. WHEN QUESTIONS ARISE DURING THE PROJECT THE CONTRACTOR SHALL SUBMIT A REQUEST FOR INFORMATION (RFI). THE CONTRACTORS SHOULD REALIZE THAT RFI'S CANNOT AND WILL NOT BE ANSWERED INSTANTLY DUE TO THE TIME OF ROUTING FROM THE POINT OF THE QUESTION TO THE POINT OF THE ANSWER AND BACK (MINIMUM OF 14 WORKING DAYS). THEREFORE RFI'S SHOULD BE SENT WHEN THE QUESTION IS NOT TIME SENSITIVE. TIME SENSITIVE QUESTIONS SHOULD BE HANDLED BY PHONE CALL FOR IMMEDIATE RESPONSE AND FOLLOWED WITH APPROPRIATE DOCUMENTATION OF THE QUESTION AND ANSWER GIVEN.
- 4. THE SUB-CONTRACTOR(S) FOR THE MECHANICAL SYSTEMS SHALL SUBMIT ALL SHOP DRAWINGS PER THE MECHANICAL SPECIFICATIONS IN DIVISION 23 GENERAL PROVISIONS SECTION. ALL SHOP DRAWINGS SHALL BE SUBMITTED WITHIN 30 DAYS OF THE GENERAL CONTRACTOR RECEIVING THE CONTRACTORS CONTRACT FROM THE OWNER (EXCEPT DUCTWORK SHOP DRAWINGS-45 DAYS). SUBMITTALS TAKE APPROXIMATE 30 WORKING DAYS FOR REVIEW AND RETURN BACK TO THE SUBMITTING SUB-CONTRACTOR . ON LONG LEAD TIME, EQUIPMENT SUBMITTAL, THE SUBMITTALS WILL BE EXPEDITED BY SPECIAL PROCEDURE TO BE DETERMINED AT TIME OF SUBMITTAL.
- 5. THE SUB-CONTRACTOR SHALL BE AWARE THAT PAINTING OF PIPE AND EQUIPMENT IS CALLED FOR IN THE PLANS AND IN THE SPECIFICATIONS. IT IS THE RESPONSIBILITY OF THE SUB-CONTRACTORS INSTALLING THE SYSTEMS ON THESE PLANS TO HAVE THE PAINTING PROVIDED. REFER TO SPECIFICATIONS.
- 6. THE SUB-CONTRACTORS FOR THE SYSTEMS ON THESE PLANS SHALL BE RESPONSIBLE FOR COORDINATION WITH ALL TRADES AND TO AVOID CONFLICT. COORDINATE ALL ELECTRICAL REQUIREMENTS PRIOR TO MAKING THE SHOP DRAWING SUBMITTALS. WHEN CONFLICTS OCCUR AND THE CONFLICT IS NOT RESOLVED BY THE GENERAL CONTRACTOR OR BETWEEN THE SUB-CONTRACTORS, THE ARCHITECT/ENGINEER SHALL ADVISE ON THE RESOLUTION OF THE CONFLICT WITHOUT ADDITIONAL COST TO THE OWNER. CONFLICTS ARE AVOIDED BY PROPER COORDINATION OF WORK.

	MECHANICAL LEGEND
SYMBOL	DESCRIPTION
A.F.F.	ABOVE FINISHED FLOOR
A.F.G.	ABOVE FINISHED GRADE
T	THERMOSTAT
S	REMOTE SENSOR

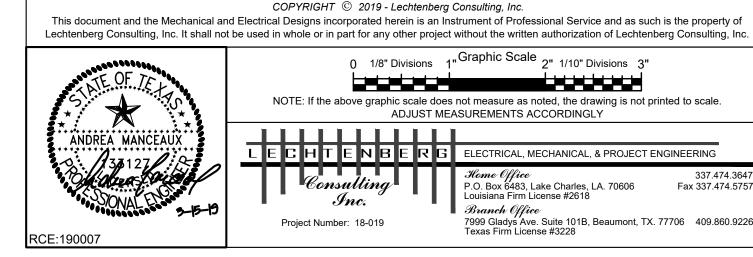


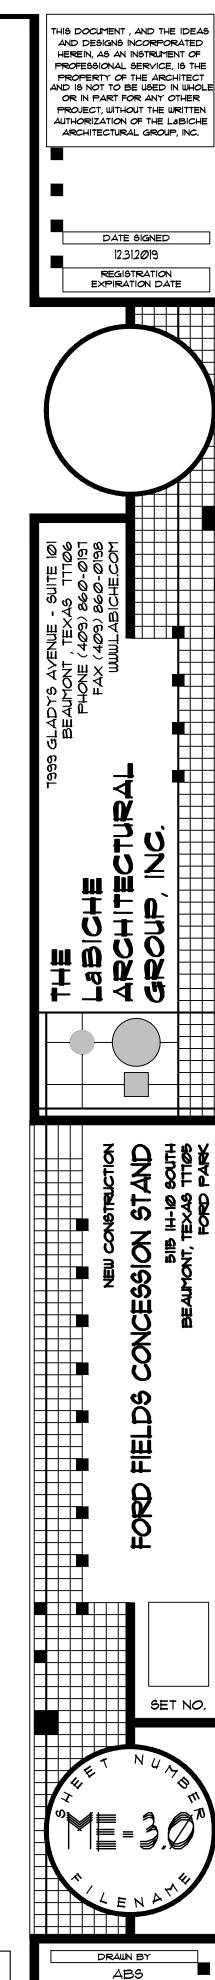


ABS PROJECT NUMBER 15036 DOCUMENT RELEASE DATES BIDS & CONSTRUCTION - 3/15/1 P.O. Box 6483, Lake Charles, LA. 70606 Fax 337.474.5757 7999 Gladys Ave. Suite 101B, Beaumont, TX. 77706 409.860.9226 Texas Firm License #3228 COPYRIGHT © 2019 HE LABICHE ARCHITECTURAL

Louisiana Firm License #2618

Branch Office

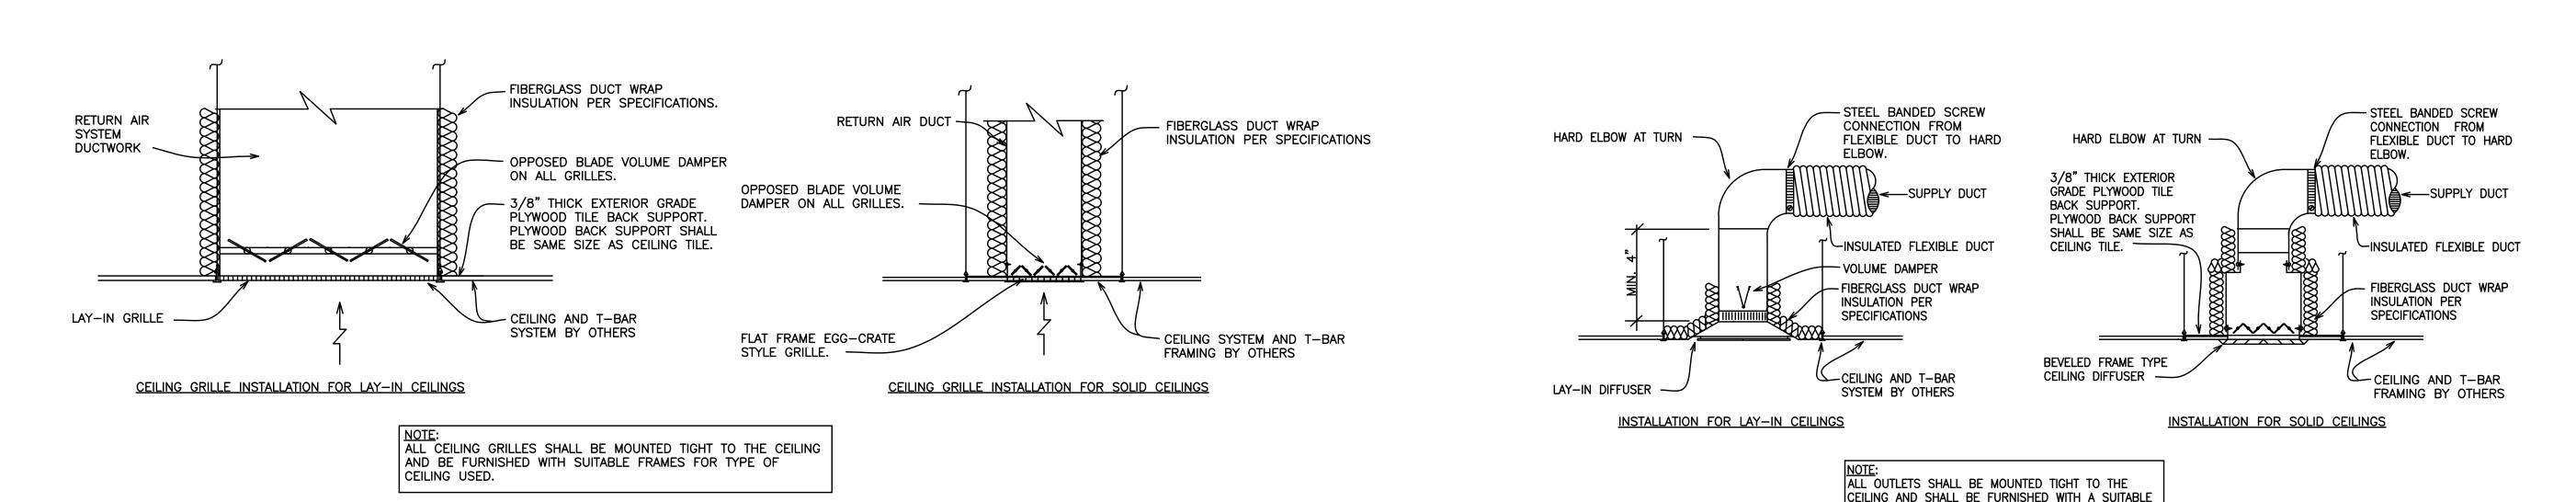


CEILING GRILLE INSTALLATION DETAIL

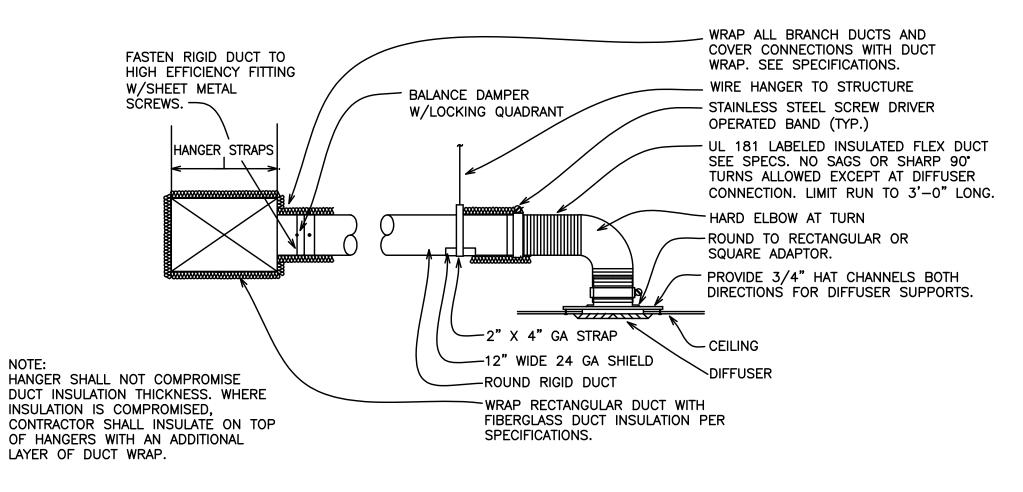

3. PROVIDE SUPPORT ON ALL BRANCH IN AREAS WHERE FIRE DAMPERS ARE DUCT RUNOUTS. MINIMUM OF TWO REQUIRED, PROVIDE DEEP ROUND TO SUPPORTS ON BRANCH DUCTS OVER RECTANGULAR OR SQUARE ADAPTER AND 6'-0" IN LENGTH. BUILD GYPSUM BOARD ENCLOSURE. 2. NO POP RIVETS ALLOWED. 4. DO NOT LINE DUCTWORK.


> TYPICAL DIFFUSER CONNECTION DETAIL NO SCALE

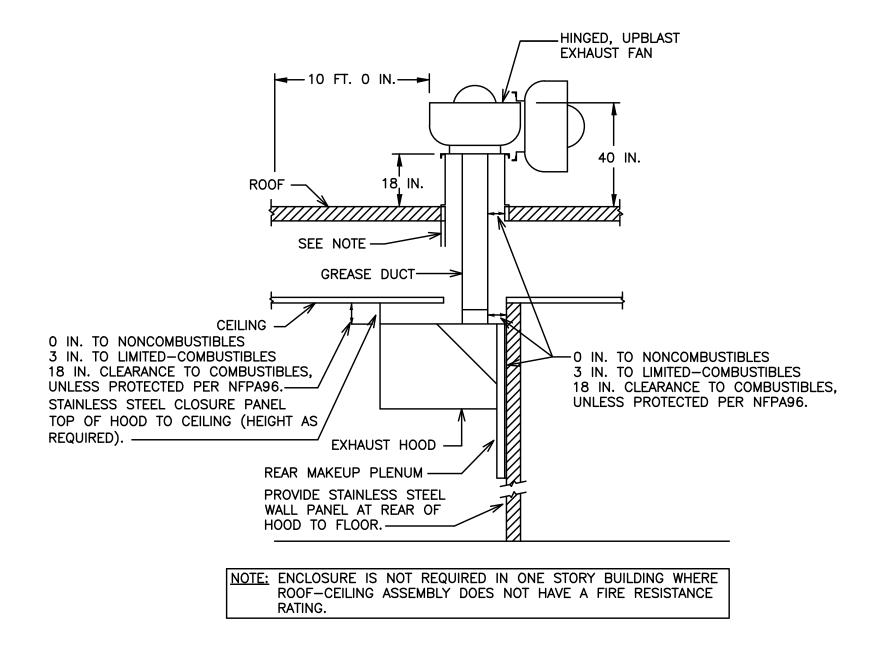

FRAME FOR THE TYPE OF CEILING USED.

SUPPLY AIR

DIFFUSER DETAIL

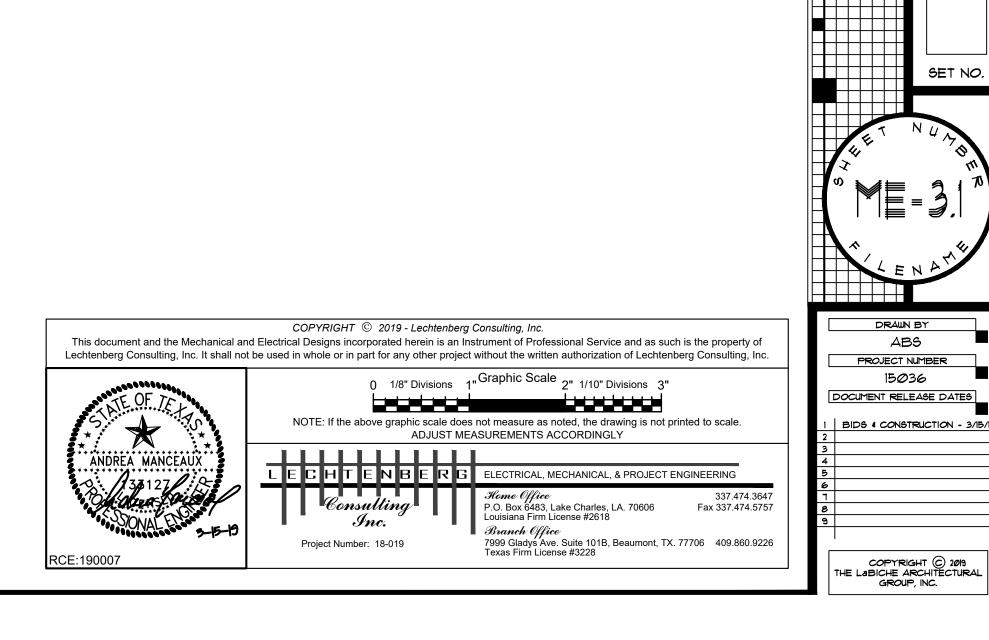

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN

AUTHORIZATION OF THE LABICHE ARCHITECTURAL GROUP, INC.

DATE SIGNED

12.31.2019

REGISTRATION EXPIRATION DATE

₹ <u>0</u> ₹ £ £ £

																									·
	FAN						COOLING						HEATING						UNIT ELECTRICAL						
									ENTERI TE	ING AIR			5511		4.46			5),T	15445		HEATIN	G BTUH		ELECTRICAL	ADDROVED MANUEACTUREDS
NO.	SERVICE	MIN. CFM	CFM F.A.	EXT. S.P.	NOMINAL TONNAGE	FAN H.P.	ELECTRICAL SERVICE	COOLING CAPACITY BTUH	DB (°F)	WB (°F)	LEAVE AIR (°F) COIL	LEAVE AIR (°F) UNIT	DEW POINT (°F)	MIN EER	AMB. TEMP. (°F)	HOT GAS REHEAT BTUH	TYPE	ENT. AIR (°F)	LEAVE AIR (°F)	NO. STAGES	INPUT	OUTPUT	UNIT FLA	ELECTRICAL SERVICE	APPROVED MANUFACTURERS
RTU-1	CONCESSIONS	4400	1400	0.95	16.4	3	480-3-60	196,376	81	68	53.7	53.6	53.6	10.8	95	101,898	NAT. GAS	58	96	MODULATING	300,000	240,000	30.6	480-3-60	AAON, DAIKIN OR APPROVED EQUAL.

NOTES:

1. PACKAGED EQUIPMENT SHALL BE FURNISHED WITH CONTROLLER, FURNISHED BY MANUFACTURER.

2. PACKAGED ROOFTOP UNIT SHALL HAVE DUCT SMOKE DETECTOR IN SUPPLY AND RETURN AIR DUCTWORK, INTERLOCK WITH FIRE ALARM SYSTEM WHERE FIRE ALARM IS PRESENT. WHERE NO FIRE ALARM EXISTS PROVIDE REMOTE AUDIBLE/VISUAL ANNUNCIATOR ON WALL IN CONTINUOUSLY OCCUPIED SPACE.

3. MECHANICAL CONTRACTOR AND MANUFACTURER SHALL PREPARE AN INSTALLATION SHOP DRAWING (AT 1/4"=1'-0" SCALE) FOR PACKAGED UNIT INDICATING REQUIRED CLEARANCES, ASSOCIATED PIPING AND DUCTWORK. 4. ALL PACKAGED ROOFTOP EQUIPMENT: PROVIDE AND INSTALL AIRFLOW MEASURING STATION (EBTRON GTX116 TRANSMITTER AND SENSOR) IN SUPPLY AND RETURN AIR OF AIR HANDLING UNIT. COORDINATE ELECTRICAL CONTRACTOR IN THE FIELD. ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CONTROL CIRCUITS AND MECHANICAL CONTRACTOR SHALL EXTEND AND CONNECT ALL CONTROL WIRING.

5. ROOFTOP UNIT SHALL BE FURNISHED WITH MOTORIZED OUTSIDE AIR DAMPER INTERLOCKED TO UNIT OPERATION.

6. ALL UNITS SHALL BE FURNISHED WITH LOW AMBIENT CONTROL.

PROVIDE WITH FACTORY MOUNTED THROUGH THE CURB UTILITIES. 8. PROVIDE WITH FACTORY FUSED DISCONNECT.

9. PROVIDE STAINLESS STEEL HEAT EXCHANGER FOR ALL GAS FIRED HEAT.

10. ALL PACKAGED EQUIPMENT TO BE FURNISHED WITH HOT GAS REHEAT DEHUMIDIFICATION OPTION.

11. PROVIDE ALL EQUIPMENT WITH LOUVERED HAIL GUARDS. 12. CURB INSTALLATION/ASSEMBLY SHALL MEET THE PROJECT WIND LOAD REQUIREMENTS PER IBC AS FURNISHED BY THE ARCHITECT/STRUCTURAL ENGINEER.

					GRILLE/	LOUVER SCHEDULE
SYMBOL	SIZE	SERVICE	LOCATION	CONSTRUCTION MATERIAL	FINISH	REMARKS
G-1	24"X24"	RETURN/ TRANSFER	CEILING	ALUMINUM	WHITE	NAILOR 51EC-O, PRICE OR TITUS.

1. ALL GRILLES SHALL BE FURNISHED WITH OPPOSED BLADE DAMPERS.

2. TRANSITION DUCTWORK TO FULL FACE OF GRILLE. 3. FRAME STYLE SHALL MATCH ADJACENT CONSTRUCTION.

	FAN SCHEDULE											
MARK	MARK SERVICE MIN. EXT. MAX FAN TYPE DRIVE ELECTRICAL SERVICE							APPROVED MANUFACTURERS				
EF-1	HOOD EXHAUST 12FT HOOD	3000	1.1	1340	1.5	CENT	BELT	208-3-60	ACCUREX OR APPROVED EQUAL.			
EF-2	HOOD EXHAUST 5FT HOOD	1250	1.1	1340	0.75	CENT	BELT	208-3-60	ACCUREX OR APPROVED EQUAL.			
SF-1	HOOD SUPPLY	3400	00 0.550 628 1.5 CENT BELT		BELT	208-3-60	ACCUREX OR APPROVED EQUAL.					

1. EXISTING 12FT AND 5FT LONG KITCHEN HOODS FURNISHED BY OWNER, INSTALLED BY CONTRACTOR. PROVIDE NEW DUCTWORK, SUPPLY PLENUM AND EXHAUST/MAKEUP AIR FANS. 2. ALL ROOF MOUNTED FANS SHALL BE FURNISHED WITH ROOF CURB. ALL FANS AND CURBS SHALL BE WIND RATED.

3. KITCHEN HOOD FAN SWITCH MOUNTED TO FACE OF HOOD. EXHAUST AND SUPPLY FANS SHALL OPERATE SIMULTANEOUSLY.

					AIR CURTAIN SCHEDULE
MARK	LOCATION	CFM OUTPUT	MOTOR HP	ELECTRICAL SERVICE	REMARKS
AC-1	COUNTER	2072	1/5	208-1-60	BERNER SERIES ALCO8-1072A OR APPROVED EQUAL.
AC-2	COUNTER	2072	1/5	208-1-60	BERNER SERIES ALCO8-1072A OR APPROVED EQUAL.
AC-3	COUNTER	2072	1/5	208-1-60	BERNER SERIES ALCO8-1072A OR APPROVED EQUAL.
AC-4	COUNTER	2072	1/5	208-1-60	BERNER SERIES ALCO8-1072A OR APPROVED EQUAL.
AC-5	COUNTER	2072	1/5	208-1-60	BERNER SERIES ALCO8-1072A OR APPROVED EQUAL.
AC-6	COUNTER	2072	1/5	208-1-60	BERNER SERIES ALCO8-1072A OR APPROVED EQUAL.
AC-7	DOOR	1020	1/5	208-1-60	BERNER SERIES SLCO7-1036A OR APPROVED EQUAL.
AC-8	DOOR	2031	1/5	208-1-60	BERNER SERIES SLCO7-1072A OR APPROVED EQUAL.

COORDINATE MOUNTING OF AIR CURTAINS AC-1 THROUGH AC-6 WITH CONCESSION WINDOW COILING MECHANISM.


2. ALL AIR CURTAINS SHALL BE HUNG PER MANUFACTURER. FURNISH ALL HANGERS, BRACKETS, ETC FOR A COMPLETE INSTALLATION. 3. AIR CURTAIN AC-1 THROUGH AC-6 SHALL BE FURNISHED WITH CONTROL PACKAGE TO INCLUDE TIME DELAY SHUTDOWN. UNIT SHALL HAVE 10 FAN SPEED ADJUSTMENTS. ALL LOW VOLTAGE CONTROL WIRING SHALL BE THE RESPONSIBILITY OF THE MECHANICAL CONTROLS CONTRACTOR. REFER TO ELECTRICAL PLANS FOR WALL SWITCHING REQUIREMENTS DOOR SWITCH TO BE FURNISHED WITH AIR CURTAIN FOR FUTURE, NOT INSTALLED AT THIS TIME.


4. AIR CURTAIN AC-7 AND AC-8 SHALL BE FURNISHED WITH CONTROL PACKAGE TO INCLUDE DOOR SWITCH AND TIME DELAY SHUTDOWN. UNIT SHALL HAVE SINGLE SPEED FAN ADJUSTMENT. ALL LOW VOLTAGE CONTROL WIRING SHALL BE THE RESPONSIBILITY OF THE MECHANICAL CONTROLS CONTRACTOR.

	CEILING DIFFUSER SCHEDULE										
MARK	DIFFUSER SIZE	CFM RANGE	CONSTRUCTION MATERIAL	FINISH	REMARKS						
D-1	6" Ø	0-95	ALUMINUM	WHITE	NAILOR 6200-0, PRICE OR TITUS.						
D-2	8" Ø	100-190	ALUMINUM	WHITE	NAILOR 6200-0, PRICE OR TITUS.						
D-3	10 " Ø	195-300	ALUMINUM	WHITE	NAILOR 6200-0, PRICE OR TITUS.						
D-4	12 " Ø	305-420	ALUMINUM	WHITE	NAILOR 6200-0, PRICE OR TITUS.						
D-5	1 4" Ø	425-640	ALUMINUM	WHITE	NAILOR 6200-0, PRICE OR TITUS.						
D-6	16 " Ø	645-860	ALUMINUM	WHITE	NAILOR 6200-0, PRICE OR TITUS.						
					1						

1. FURNISH AND INSTALL ALL DIFFUSERS WITH OPPOSED BLADE DAMPERS.

4. ALL DIFFUSERS ON PLANS SHALL BE FOUR WAY DIFFUSERS UNLESS OTHERWISE NOTED.

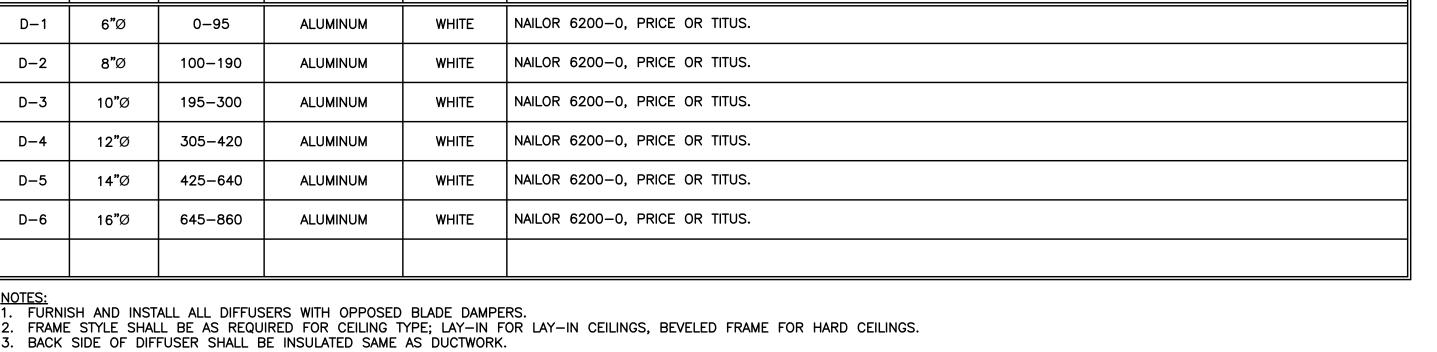

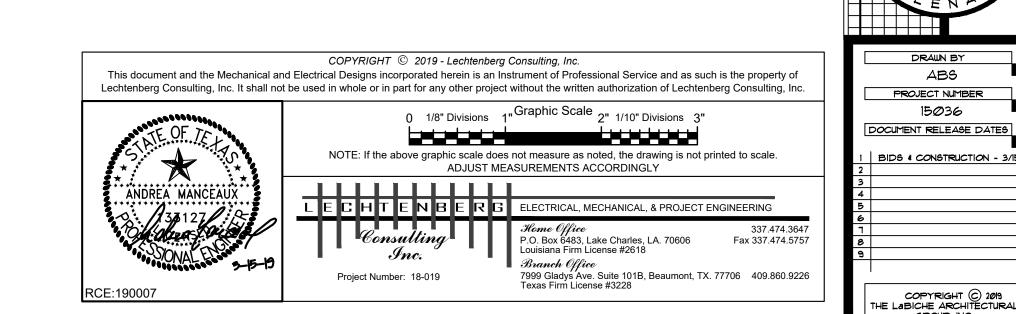

ME-3.2 13, 2019

MECHANICAL SCHEDULES

₹ **₽** ₹ **8** ₹

DRAWN BY

ABS

BIDS & CONSTRUCTION - 3/15/19


COPYRIGHT © 2019 THE LABICHE ARCHITECTURAL GROUP, INC.

PROJECT NUMBER 15036

THIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER

PROJECT, WITHOUT THE WRITTEN AUTHORIZATION OF THE LABICHE ARCHITECTURAL GROUP, INC.

> DATE SIGNED 12.31.2019 REGISTRATION EXPIRATION DATE

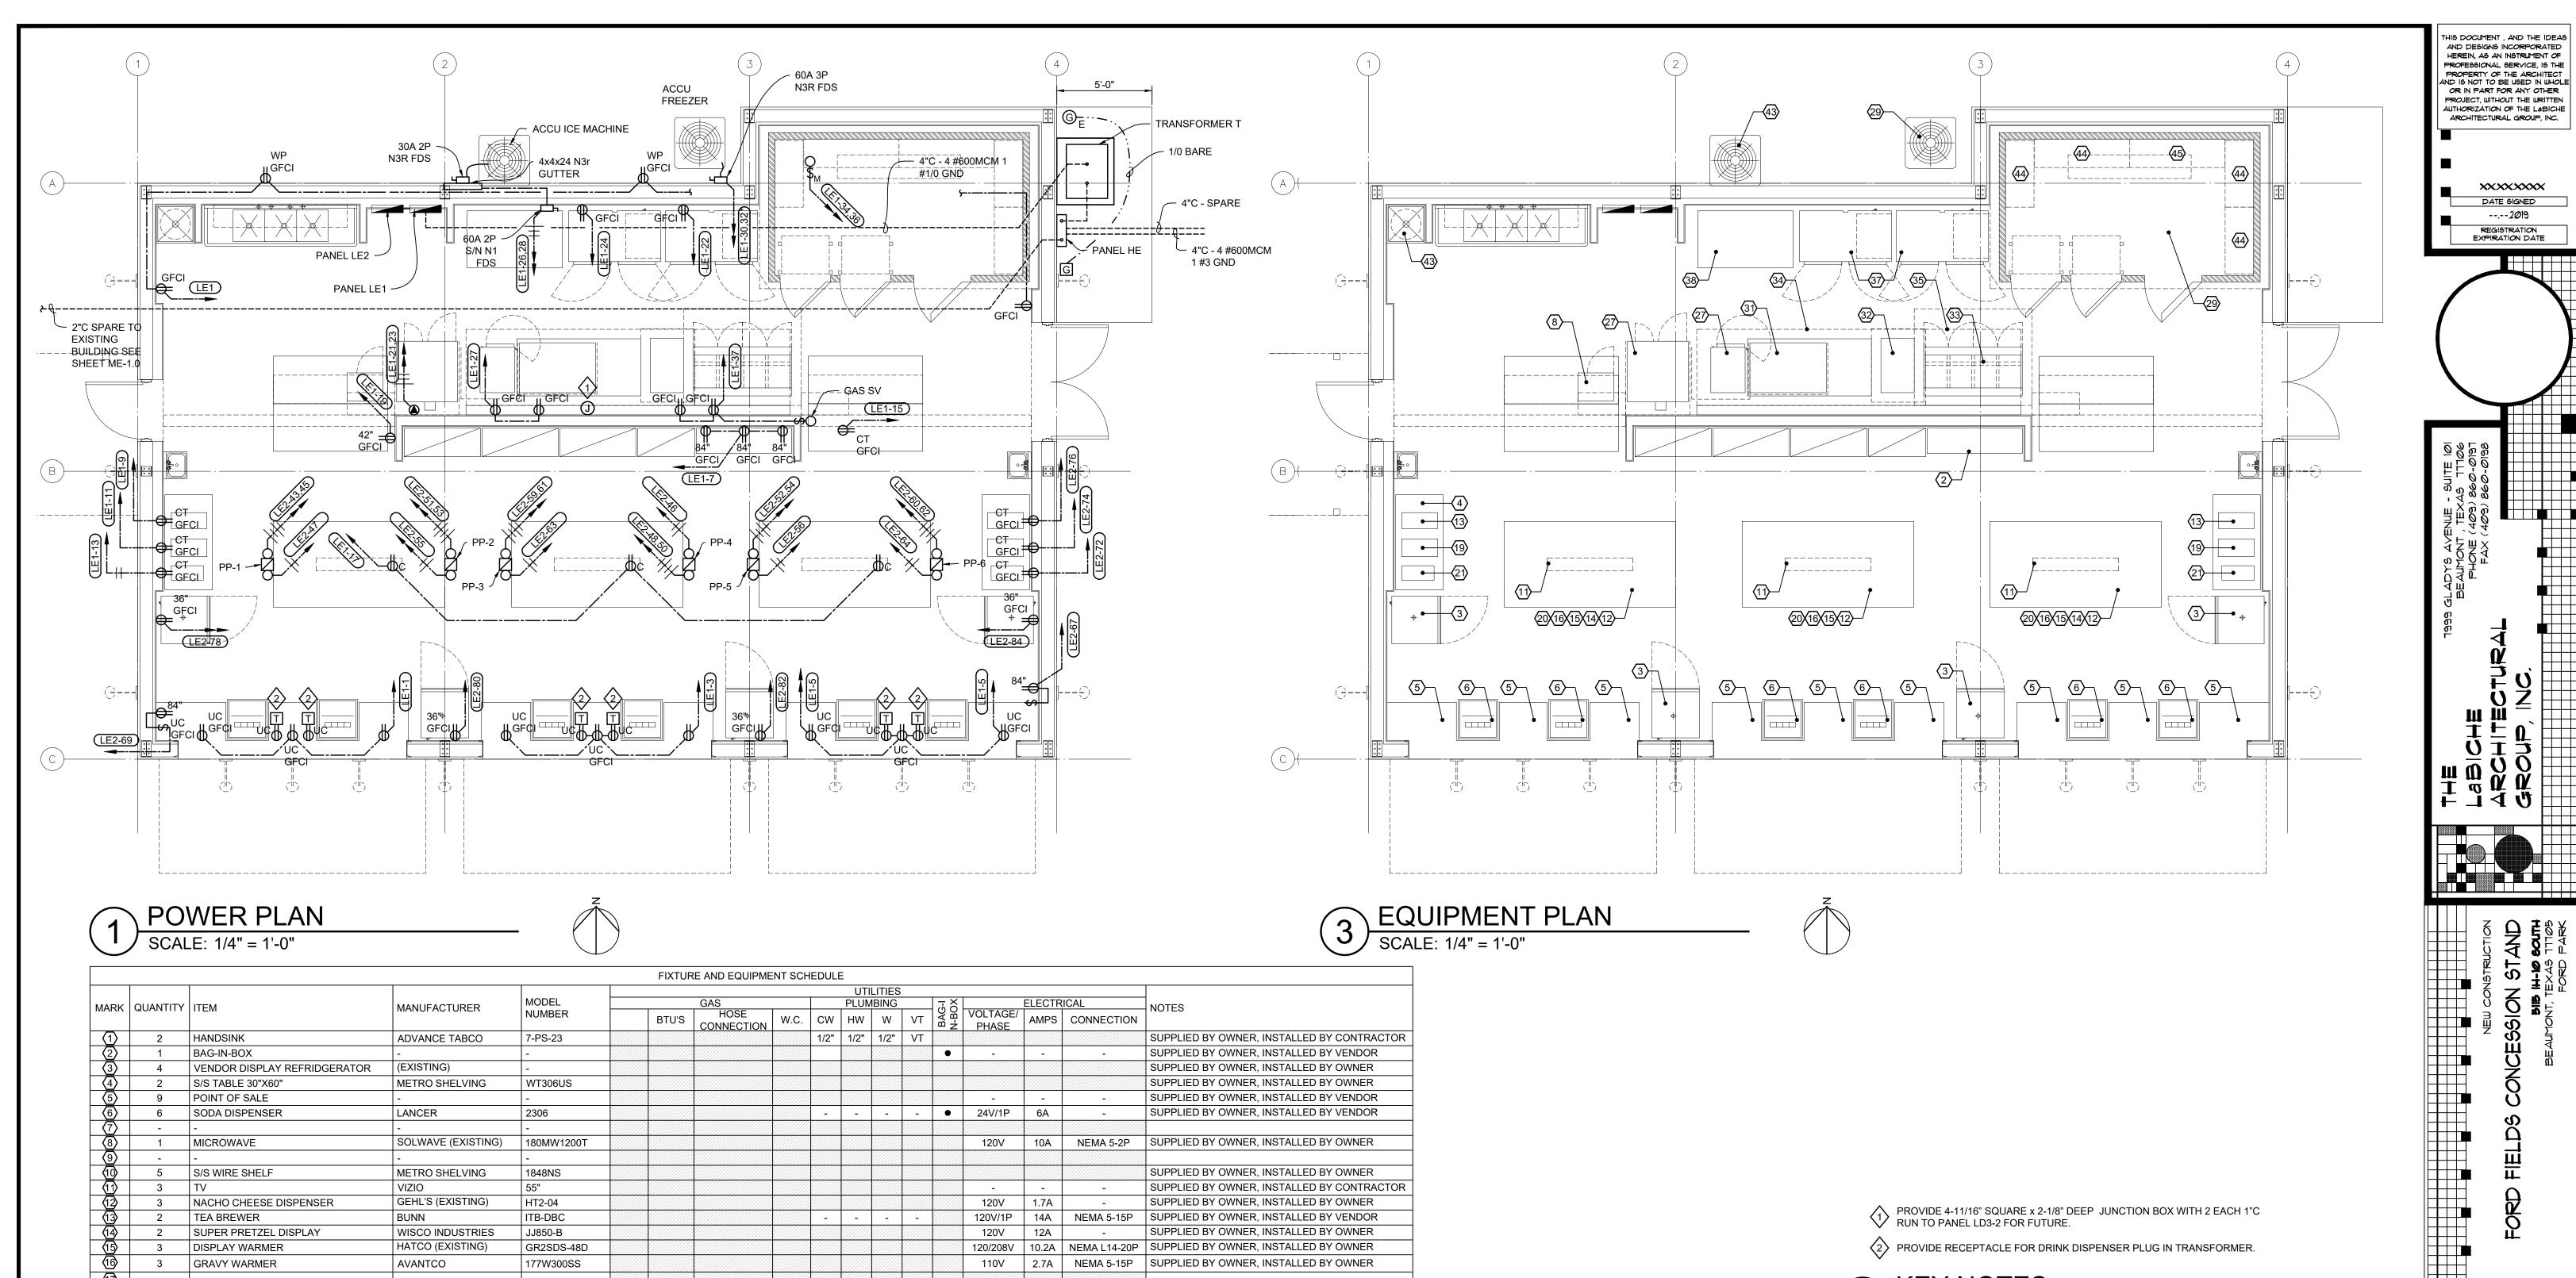

SUPPLIED BY OWNER, INSTALLED BY VENDOR

SUPPLIED BY OWNER, INSTALLED BY VENDOR

WARM BEVERAGE FMD-3 BLACK 120V/1P 15A SUPPLIED BY OWNER, INSTALLED BY VENDOR 120V | 20A | NEMA 5-15P | SUPPLIED BY OWNER, INSTALLED BY OWNER UNDER COUNTER DRAWER WARMER WITTCO 200-2-SL COFFEE BREWER CURTIS SUPPLIED BY OWNER, INSTALLED BY VENDOR GEM TS SUPPLIED BY OWNER, INSTALLED BY OWNER 3 54"X108" S/S TABLE SUPPLIED BY OWNER, INSTALLED BY OWNER ADVANCE TABCO SUPPLIED BY OWNER, INSTALLED BY OWNER S/S SHELF CU-18-72-2 4 S/S TABLE 30"X72" METRO SHELVING WT307US SUPPLIED BY OWNER, INSTALLED BY OWNER SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR CONVECTION OVEN GARLAND SCO-ES-20S 208V/1P VULCAN (EXISTING) SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR STEAMER • 90,000 3.5" 120V/1P 1.5A <u>30</u> S/S EQUIPMENT TABLE METRO SHELVING 36X78 48" GRIDDLE VULCAN (EXISTING) • 108,000 SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR ADVANCO FLOOR FRYER • 150,000 3/4" SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR FF518 4 COMP FRYER VULCAN 4GR45MF • 480,000 120V/60HZ | 6.0A | NEMA 5-15P | SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR 12' HOOD W/ ANSUL GREENHECK (EXISTING) | GHEW-12.00-S SUPPLIED BY OWNER, INSTALLED BY VENDOR GREENHECK (EXISTING) | GHEW-5.00-S SUPPLIED BY OWNER, INSTALLED BY VENDOR 5' HOOD W/ ANSUL WALK-IN FREEZER AMERIKOOLER 8'X14' FREEZER SUPPLIED BY OWNER, INSTALLED BY VENDOR REACH-IN COOLERS TRAULSEN (EXISTING) 115V/1 NEMA 5-15P | SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR ICE MACHINE SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR HOSHIZAKI KM-2600SRJ3 208/230V 20.6A (39) SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR 1 3 COMP SINK DUKE (EXISTING) 203S-218 POT RACK (EXISTING) SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR (EXISTING) SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR MOP SINK HOT WATER HEATER PALOMA (EXISTING) SUPPLIED BY OWNER, INSTALLED BY CONTRACTOR PH-24M-DN

3 S/S SHELF


S/S SHELF

NORLAKE SHELVING

NORLAKE SHELVING

18X42

FIXTURE AND **EQUIPMENT SCHEDULE**

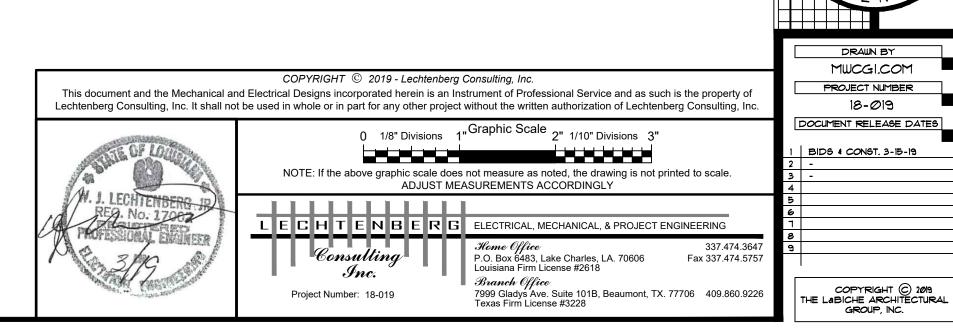


 $\times\!\!\times\!\!\times\!\!\times\!\!\times\!\!\times\!\!\times$ DATE SIGNED


--.--2019

ICESSI

18-019

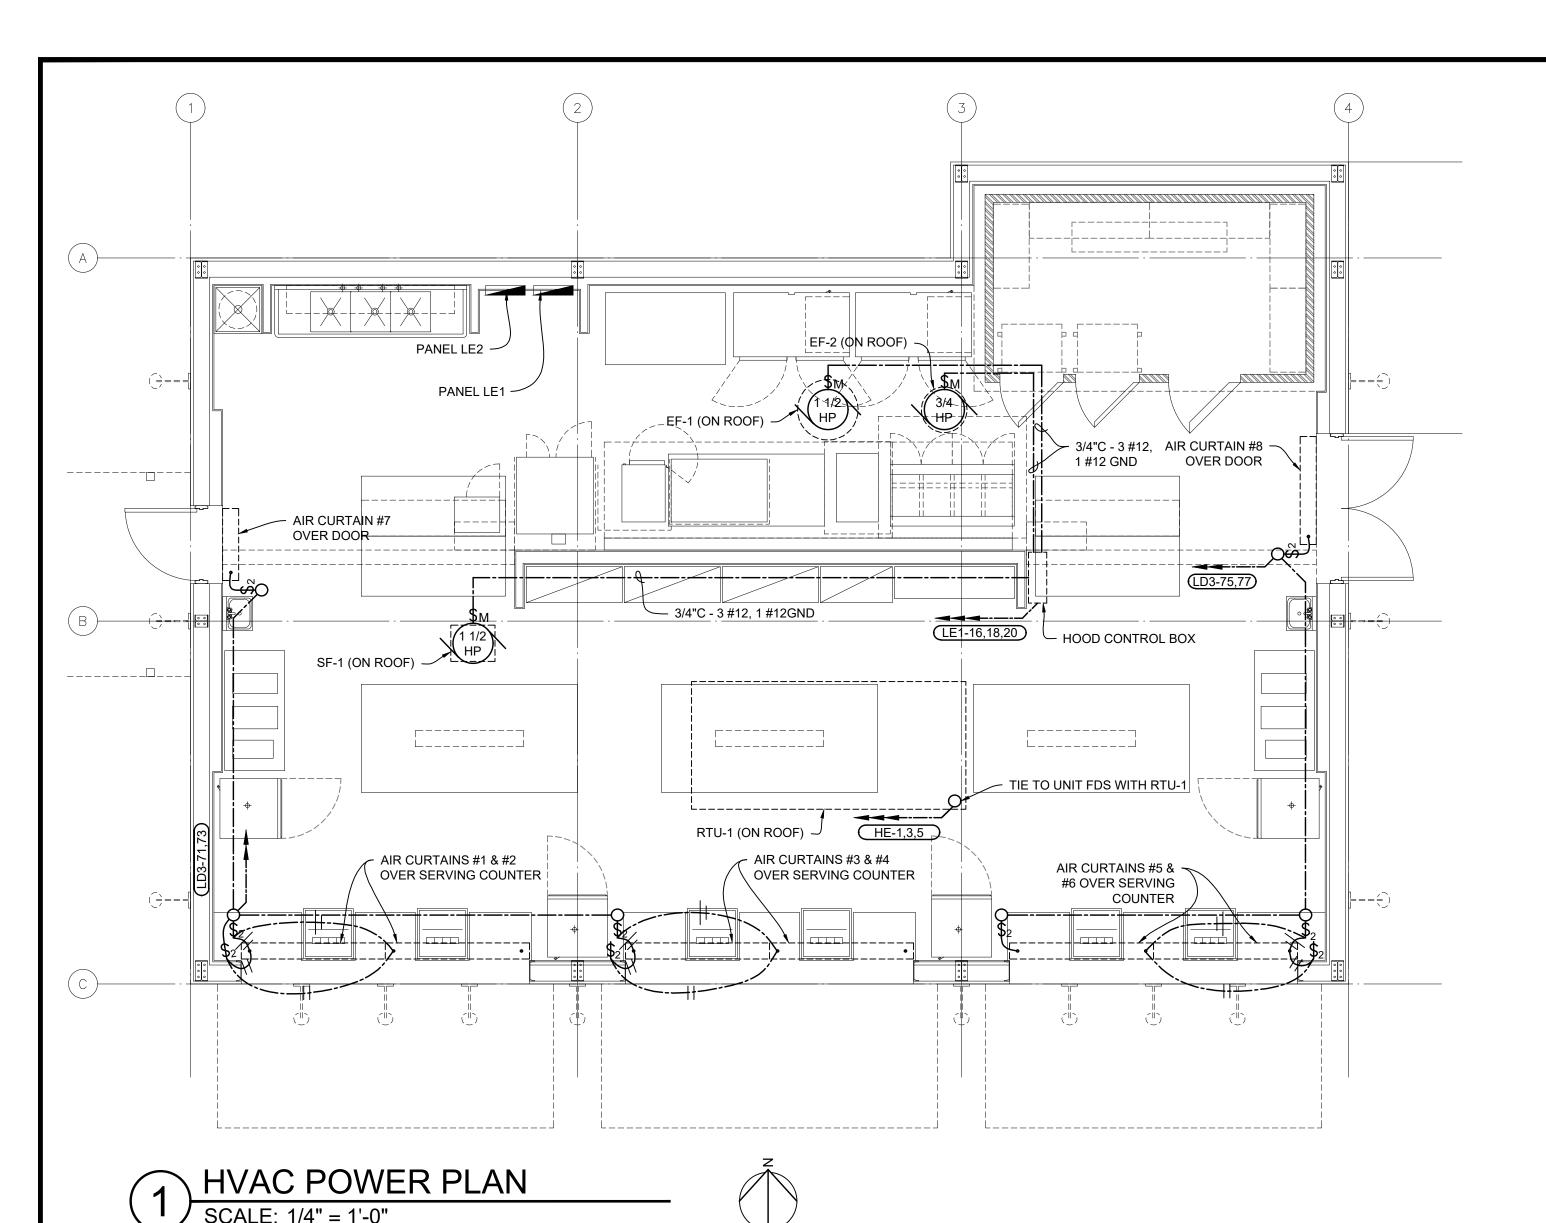


SERVING COUNTER AIR CURTAINS

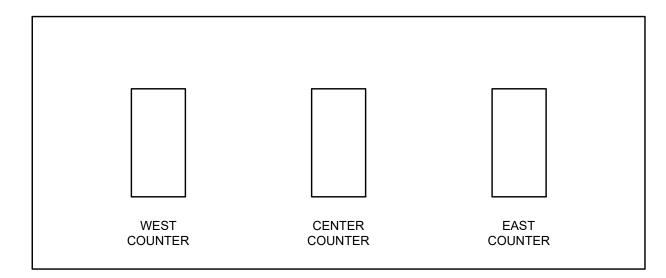

SERVING COUNTER AIR CURTAIN SWITCHES

SCALE: 3/4" = 1'-0"

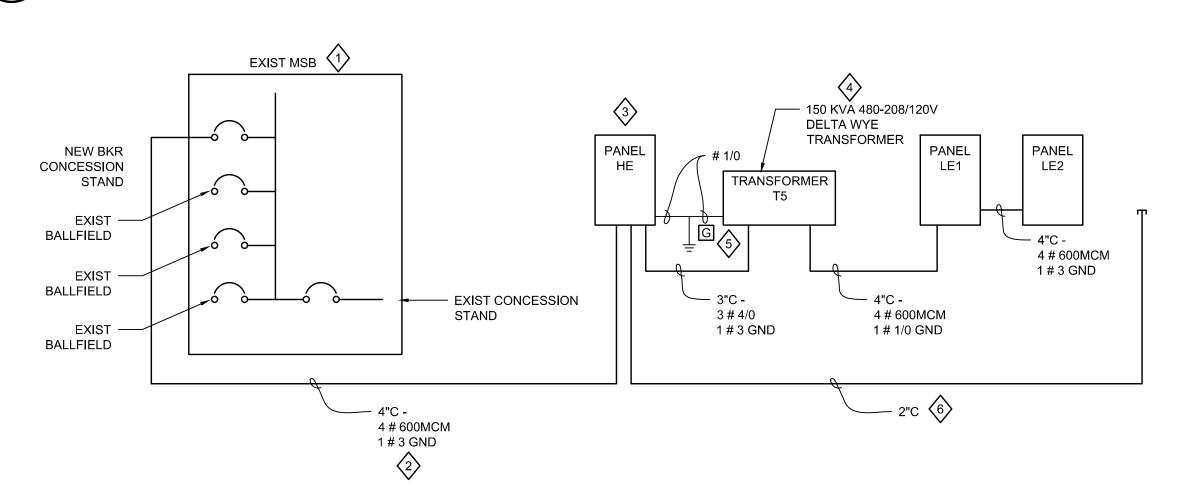

EXISTING PANEL MSB ADJACENT UTILITY TRANSFORMER BETWEEN BALFIELD COMPLEXES A AND B, SEE SITE PLAN ON SHEET ME-1.0. INSTALL NEW 400 AMP 3P SQUARE D LC36400 BREAKER IN EXISTING SQUARE D I-LINE PANELBOARD. COORDINATE ANY SERVICE OUTAGE REQUIRED WITH OWNER AND ARCHITECT.

RUN NEW 4"C - 4 #600 MCM, 1 #3 GROUND FROM NEW BREAKER TO NEW PANEL HE AT NEW CONCESSION BUILDING. BURY RACEWAY 48" BELOW GRADE AND REPAIR TRENCH AS PER DIRTWORK SPECIFICATIONS. INSTALL YELLOW MARKING TAPE OVER DUCT AND 12" BELOW GRADE.

- FURNISH AND INSTALL NEW PANEL HE. PROVIDE STRUCTURE AS REQUIRED MOUNT ON OUTSIDE OF NEW CONCESSION BUILDING. POUR CONCRETE SLAB AT PANEL AND TRANSFORMER AS INDICATED ON THE DRAWINGS. SLAB SHALL BE IN ACCORDANCE WITH CONCRETE WALK SPECIFICATIONS.
- FURNISH AND INSTALL NEW TRANSFORMER T-5. TRANSFORMER TO BE COPPER WOUND WITH 220 DEGREE C INSULLATION AND A 115 DEGREE C RISE. TRANSFORMER SHALL BE RATED NEMA 3R WITH A RODENT BARRIER ON THE BOTTOM OF THE TRANSFORMER. INSTALL A 6" HIGH CONCRETE HOUSEKEEPING PAD BELOW THE TRANSFORMER. SIZE SHALL BE 3" IN ALL DIRECTIONS LARGER THAN TRANSFORMER.
- FURNISH AND INSTALL GROUND TRIAD AT PANEL HE AND T-5 AREA. BOND TO PANEL HE AND TRANSFORMER NEUTRAL. BOND TO BUILDING STEEL AND GAS LINE AS REQUIRED BY NEC.
- RUN 2" SPARE CONDUIT FROM PANEL HE TO EXISTING CONCESSION BUILDING AND STUBUP AND CAP OUTSIDE OF THE BUILDING.

RISER DIAGRAM KEYNOTES

MAINS 400 AMP: BREAKER PANELBOARD SCHEDULE MOUNTING: FLUSH PANEL: LE1 TYPE: PANELBOARD
 MFGR:
 Sq D
 TYPE:
 NQ

 208/120
 V
 3
 PH
 4
 W

 BRANCH BREAKERS:
 BOLT ON
 NEMA RATING: GROUND BUS: EQUIP NEUTRAL BUS: 100% IER: 10,000 MODIFICATIONS: FEED THRU LUGS WRE AMP/ CIR CIR AMP/ WIRE SIZE POLE NO NO POLE SIZE ITEM #12 20/1 1 2 20/1 #12 OUTSIDE LIGHTS
#12 20/1 3 4 20/1 #12 CONCESSION LIGHTS
#12 20/1 5 6 20/1 #12 HOOD LIGHTS COUNTER 2 ITEM 5 & ITEM 6 COUNTER 3 ITEM 5 & ITEM 6 RECPT ITEM 2 #12 20/1 9 10 20/1 #12 COOLER LIGHTS & HEATERS #10 20/1 11 12 20/1 #12 COOLER LIGHTS & HEATERS RECPT ITEM 13 RECPT ITEM 19 RECPT ITEM 21 -- - 15 16 30/3 #10 KITCHEN HOOD PANEL RECPT ITEM 8 RECPT ITEM 27 RECPT ITEM 28 RECPT ITEM 29 RECPT ITEM 33 & GAS SV SHUNT TRIP POWER

NOTES TO PANEL LE1

1 PANEL TO HAVE BOTTOM FEED MAIN.

STUB 3 EACH SPARE 1" CONDUITS INTO ACCESSABLE CEILING SPACE FOR FUTURE. INTERLOCK SHUNT TRIP BREAKERS WITH HOOD EXTINGUISHING SYSTEM FIRE ALARM INTERFACE.

MAINS 400 AMP: LUGS						PAN	NELBOARD SCHEDULE
MOUNTING: FLUSH					PA	NEL:	LE2 TYPE: PANELBOARD
NEMA RATING: 1						FGR:	
GROUND BUS: EQUIP						/120	Committee (Control of the Control of
NEUTRAL BUS: 100%							H BREAKERS: BOLT ON
The second secon							
IER: 10,000					MOL	IF ICA	ATIONS:
	WIRE	AMP/	CIR	CIR	AMP/	WIRE	
ПЕМ	FER PART BEEN SIR CO	POLE	1.674449.00	17 11 11 11 11 11	POLE	(5)(5)(5)(6)	10.000
POWER POLE 1 - ITEM 12	#12	20/1	43	44	20/1	#12	POWER POLE 4 - ITEM 16
POWER POLE 1 - ITEM 15	#12	20/1	45	46	20/1		POWER POLE 4 - ITEM 17
POWER POLE 1 - SPARE RECEPTACLE	#12	20/1	47	48	20/1	#12	POWER POLE 4 - SPARE RECEPTACLE
SPARE	-	20/1	49	50	20/1	#12	POWER POLE 4 - ITEM 20
POWER POLE 2 - ITEM 14	#12	20/1	51	52	20/1	#12	POWER POLE 5 - ITEM 12
POWER POLE 2 - ITEM 16	#12	20/1	53	54	20/1	#12	POWER POLE 5 - ITEM 15
SPARE		20/1	55	56	20/1	#12	POWER POLE 5 - ITEM 18
POWER POLE 2 - ITEM 20	#12	20/1	57	58	20/1	#12	POWER POLE 5 - SPARE RECEPTACLE
POWER POLE 3 - ITEM 12	#12	20/1	59	60	20/1	#12	POWER POLE 6 - ITEM 14
POWER POLE 3 - ITEM 15	#12	20/1	61	62	20/1	#12	POWER POLE 6 - ITEM 16
SPARE		20/1	63	64	20/1		POWER POLE 6 - ITEM 17
SPARE		20/1	65	66	20/1	#12	POWER POLE 6 - ITEM 20
RECPT FUTURE WALL FAN	#12	20/1	67	68	30/1		SPARE
RECPT FUTURE WALL FAN	#12	20/1	69	70	30/1		SPARE
AIR CURTAINS #1, #2, #3, #4, & #7	#12	20/2	71	72	20/1		RECPT ITEM 20
			73	74	20/1		RECPT ITEM 19
AIR CURTAINS #5, #6, & #9	#12	20/2	75	76	20/1		RECPT ITEM 13
			77	78	20/1		RECPT ITEM 3
POWER GAS IWH & CIRC PUMP.	#12	20/1	79	80	50/1	500 0000007	RECPT ITEM 3
SPARE		20/1	81	82	20/1		RECPT ITEM 3
SPARE		20/1	83	84	20/1	#12	RECPT ITEM 3
SPARE		20/1	85	86	20/1		SPARE
SPARE		20/1	87	88	20/1		SPARE
SPARE		20/1	89	90	20/1		SPARE
SPARE		20/1	91	92	30/1		SPARE
SPARE		20/1	93	94	30/1		SPARE
SPARE		20/1	95	96	30/1	L	SPARE


NOTES TO PANEL LE2

- 1 PANEL TO HAVE TOP FEED LUGS.
- 2 STUB 3 EACH SPARE 1" CONDUITS INTO ACCESSABLE CEILING SPACE FOR FUTURE. 3 INTERLOCK SHUNT TRIP BREAKERS WITH HOOD EXTINGUISHING SYSTEM FIRE ALARM INTERFACE

MAINS 400 AMP: (SEE NOTE 1)						PAI	NELBOARD SCHEDULE		
MOUNTING: SURFACE	_				PA	NEL:	HE TYPE: DISTRIBUTION		
NEMA RATING: 3R	_				MF	GR:	Sq D TYPE: I-LINE		
GROUND BUS: EQUIP	_	480/277 V 3 PH 4 W							
NEUTRAL BUS: 100%	_				BR	ANCI	H BREAKERS: BOLT ON		
IER: 25,000		MODIFICATIONS:							
	I MIDE	A MD/	CID	CID	A MD/	VAIDE			
пем		AMP/ POLE				The state of the s			
MAIN BREAKER		400/3	1	2	225/3	#4/0	TRANSFORMER T5		
(SEE NOTE 1)			3	4		-	(SEE NOTE 2)		
		1	5	6	-	-			
SPARE		100/3		8	50/3	#6	FTU-1		
			9	10		-			
			11	12					

NOTES TO PANEL HE

- PROVIDE BRANCH MOUNTED MAIN BREAKER
- PROVIDE PADLOCK PROVISION ON THE HANDLE OF THIS BREAKER. 3 STUB SPARE 2" CONDUITS AS INDICATED ON THE DRAWINGS FOR FUTURE.
- PANEL HE

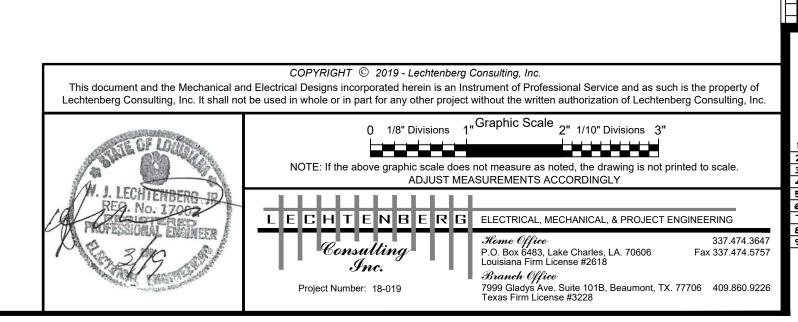

HIS DOCUMENT, AND THE IDEAS AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND IS NOT TO BE USED IN WHOL OR IN PART FOR ANY OTHER

PROJECT, WITHOUT THE WRITTEN

AUTHORIZATION OF THE LABICHE

ARCHITECTURAL GROUP, INC.

×××××××

DATE SIGNED

--.--2019


REGISTRATION EXPIRATION DATE

PROJECT NUMBER 18-019 BIDS & CONST. 3-15-19

COPYRIGHT © 2019 THE LABICHE ARCHITECTURAL GROUP, INC.

MWCGI.COM

RISER DIAGRAM

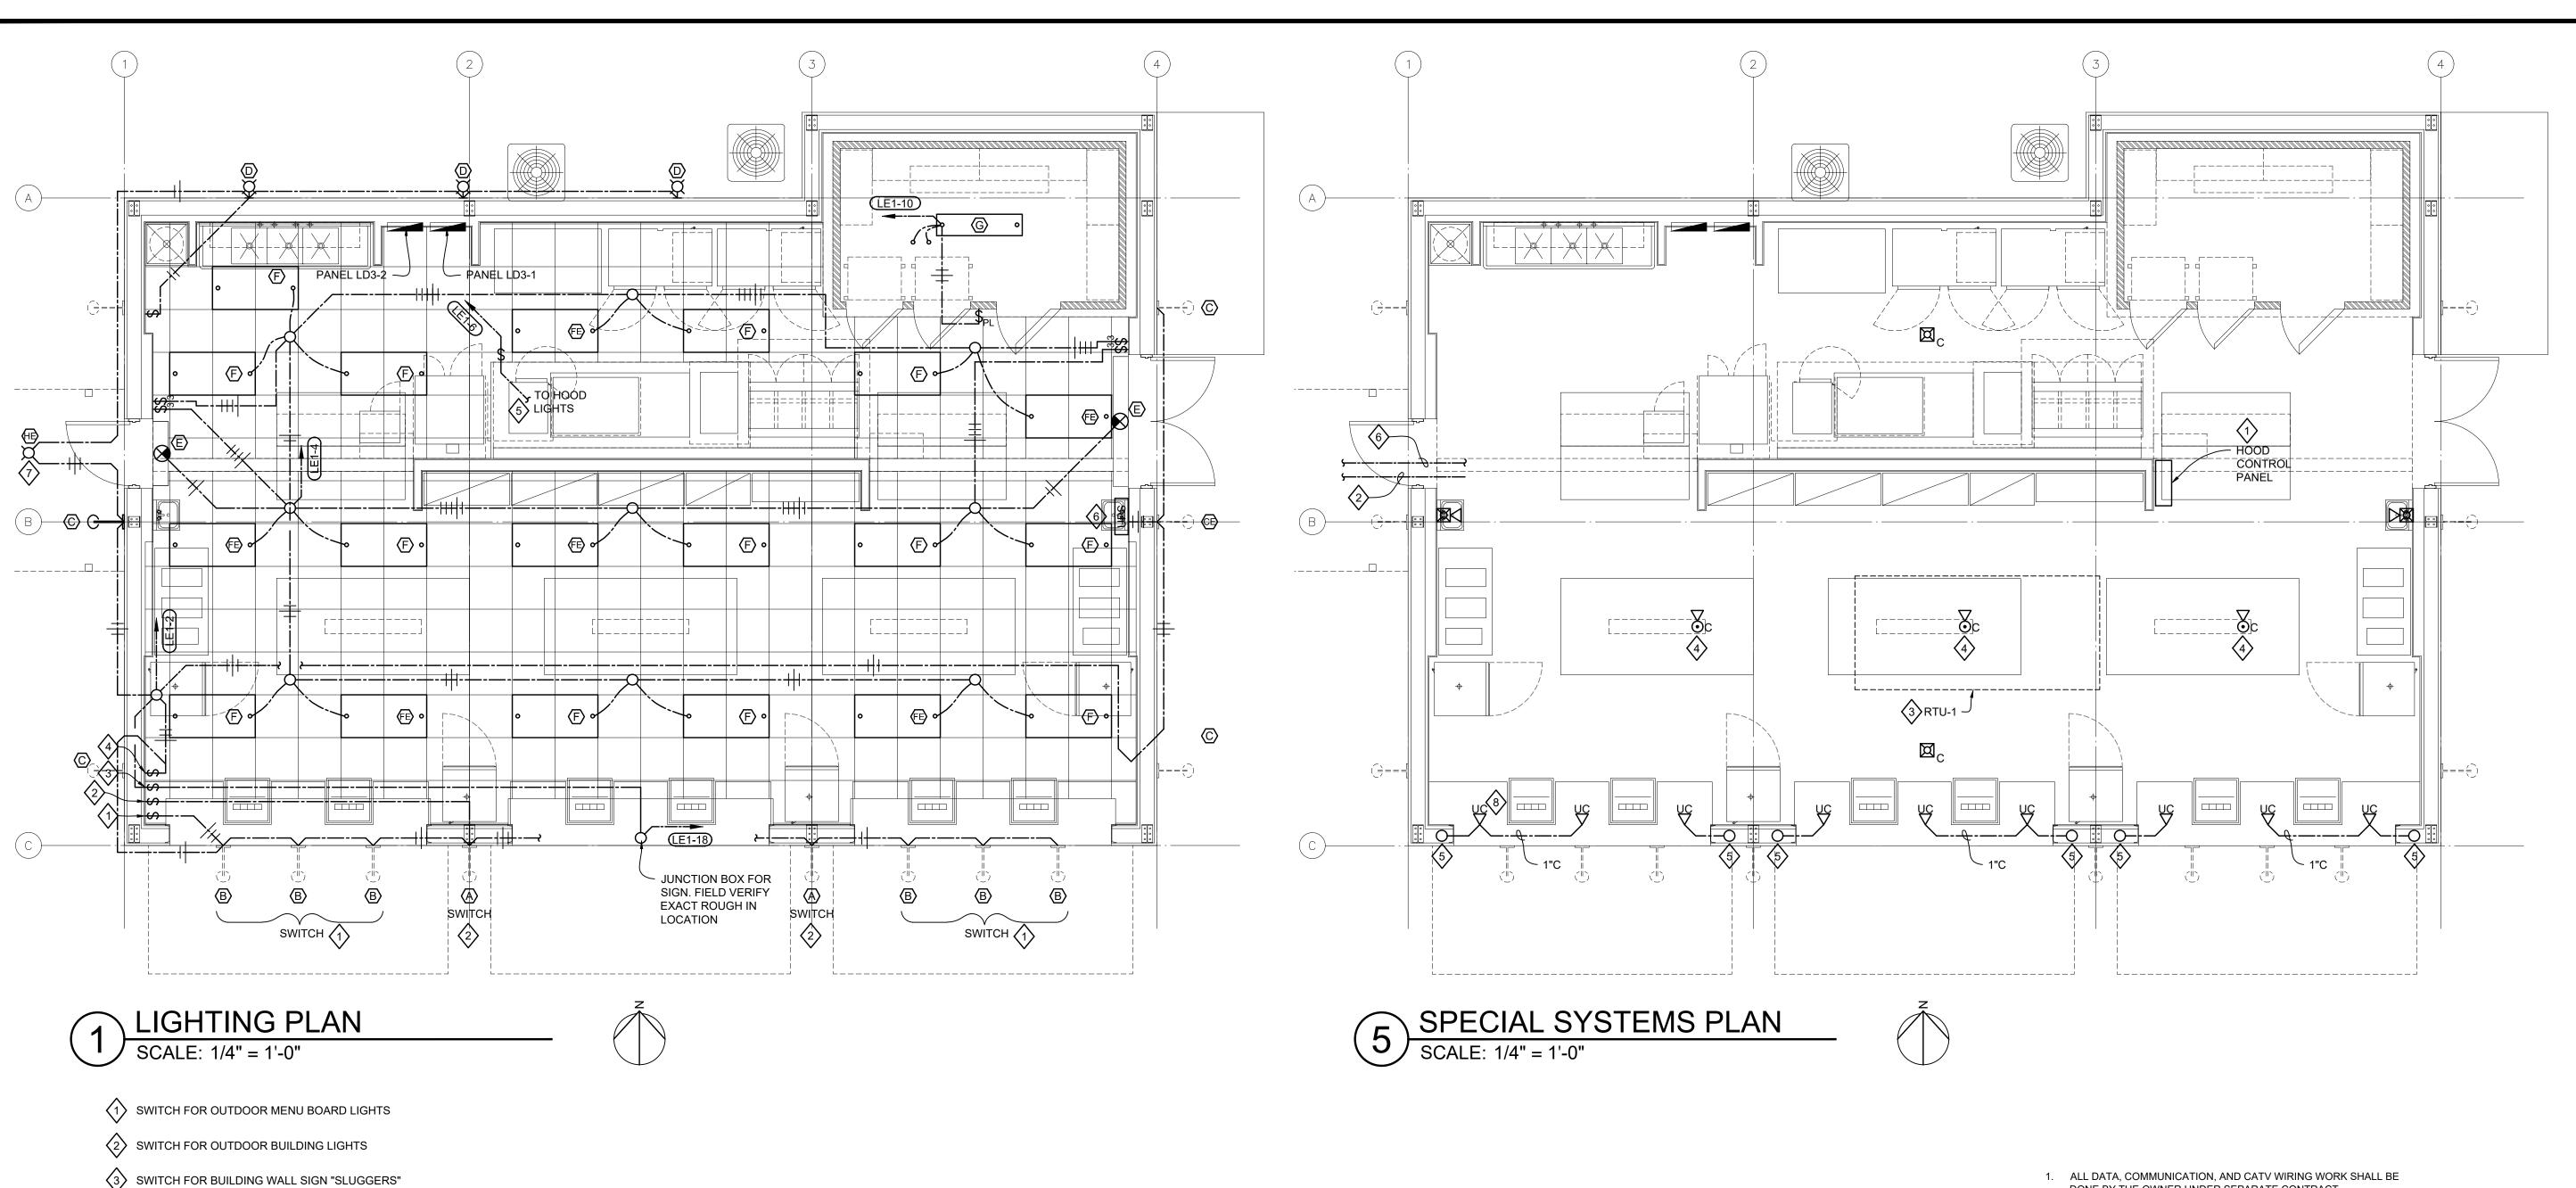

4 SWITCH FOR BUILDING WALL PACKS

5 INTERLOCK SHUNT TRIP BREAKER WITH HOOD EXTINGUISHING INTERLOCK

6 INSTALL GRID MOUNTED UPS IN CEILING TO SERVE FIXTURE CE

MOUNT FIXTURE IN CENTER OF CONNECTING CANOPY BETWEEN BUILDINGS

2 LIGHTING PLAN KEY NOTES SCALE: NONE

LICHT EIVTURE CCHERLII E

		LIGHT FIXTURE SCHEDULE		
MARK		DESCRIPTION	LAMPS	NOTES
Α	TROY RLM	#3RA12-LED18-GA / 3 SL23 GA	LED	1
В	TROY RLM	#3RH16-LED18-GA FGWC / 3 SL23 GA	LED	1
С	TROY RLM	#3RH14-LED18-GA FGWC / 3 SL23 GA	LED	4
D	LUMARK	#XTORSARL-N-PC1-	LED	5
E	SURE-LITES	#TPX70-R	LED	3
F	METALUX	#24GR-FA-LD4-38-A19/156-UNV-L835-SD1-G1	LED	2
G		VAPOR PROOF FIXTURE PROVIDED WITH FREEZER		6
Н	FAIL-SAFE	#TRR15 LD4-40W-40-UNV-ED-C1-EL12W/CSTG	LED	7

- 1. SEE ARCHITECTURAL DETAILS FOR MOUNTING HEIGHT AND LOCATION. 2. PROVIDE EMERGENCY BATTERY PACK AND CONNECT TO UNSWITCHED CONDUCTOR
- FROM BRANCH BREAKER ON UNITS NOTED WITH AN "E".
- 3. FACES, CHERVON DIRECTIONAL ARROWS, AND MOUNTING AS REQUIRED BY PLAN AND FIELD
- 4. MOUNT AT 10' AFF +/- ON SIDE OF BUILDING. FIELD VERIFY EXACT LOCATION IN FIELD WITH ARCHITECT.
- MOUNT AT 9' +/- ON BACK WALL.
- 6. CONNECT TO CIRCUIT AS INDICATED ON DRAWINGS. 7. PROVIDE STANDARD HARDWARE ON THIS FIXTURE.
- 4 LIGHT FIXTURE SCHEDULE SCALE: NONE

- SEE SHEET ME-1.0 FOR LEGEND.
- WIRE COUNTS ARE INDICATED TO PROVIDE THE CONTRACTOR AN IDEA OF THE INTENDED SWITCHING OF CIRCUIT. THEY DO NOT INCLUDE THE EQUIPMENT GROUNDING CONDUCTOR. CONTRACTOR HOWEVER IS RESPONSIBLE FOR PROVIDING THE WIRING REQUIRED TO CONTROL THE CIRCUITS. CONTACT THE ENGINEER WITH ANY QUESTIONS.

LIGHTING NOTES

- PROVIDE FA SYSTEM IN LEKFACE FOR MICHAEL SYSTEM AND CONTROL OF HOOD SUPPLY FAN AND LIGHTS. PROVIDE FA SYSTEM INTERFACE FOR MONITORING HOOD EXTINGUISHING
- RUN A 2"C WITH PULLWIRE FROM CEILING SPACE OF NEW CONCESSION STAND TO BACKBOARD SHOWN ON SHEET ME-1.0. CONDUIT TO BE ROUTED ON THE TOP OF THE CONNECTING CANOPY. SEAL BOTH WALLS AT ENTRY POINTS.
- PROVIDE FA SYSTEM INTERFACE FOR MONITORING THE DUCT DETECTORS IN SUPPLY AND RETURN AIR DUCTS OF RTU-1.
- PROVIDE 2 GANG STAINLESS STEEL PLATE IN CEILING FOR MONITOR DATA / COM WIRING. COORDINATE EXACT DEVICE CONNECTOR TYPES AND LOCATIONS IN PLATES WITH OWNER IN FIELD.
- RUN 1"C TO WALL AND UP TO ACCESSIBLE CEILING SPACE FOR DATA/COM WIRING. EXTEND RACEWAY BEYOND AIR CURTAINS IN CEILING
- RUN 1"C FOR FIRE ALARM SYSTEM WIRING FROM NEW BUILDING TO EXISTING FA PANEL FOR NEW NOTIFICATION AND ALARM DEVICES.

6 SPECIAL SYSTEM KEY NOTES SCALE: NONE

- DONE BY THE OWNER UNDER SEPARATE CONTRACT. CONTRACTOR SHALL PROVIDE RACEWAYS WITH PULLWIRES, JUNCTION BOXES, ETC. CONTRACTOR SHALL COORDINATE THE FINAL LOCATION OF JUNCTION BOXES WITH EQUIPMENT AND BUILT-IN SHOP DRAWINGS AND ARCHITECT IN FIELD.
- 2. THE BUILDING IS TO BE PROTECTED BY AN AUTOMATIC FIRE ALARM SYSTEM EXTENDED FROM THE EXISTING FIRE ALARM PANEL (FACP) SEE SHEET ME-1.0 FOR LOCATION.
- 3. THE EXTENSION OF THE EXISTING FIRE ALARM SYSTEM SHALL BE DESIGNED AND INSTALLED BY A LICENSED FIRE ALARM CONTRACTOR IN THE JURISDICTION OF THE PROJECT. THE FIRE ALARM SYSTEM DESIGN SHALL BE APPROVED BY THE AHJ, ARCHITECT, AND ENGINEER PRIOR TO ANY WORK BEING DONE. CONTRACTOR SHALL PAY ALL AHJ REVIEW FEES FOR SUBMITTAL AND ANY RESUBMITTALS.
- 4. ALL EXPOSED CABLE IN CEILING SPACE SHALL BE PROPERLY SUPPORTED FROM STRUCTURE WITH SUPPORTS DESIGNED FOR THE PURPOSE. DO NOT LAY CABLE ACROSS CEILING GRIDS.
- 5. PROVIDE BLANK COVERS TO MATCH WIRING DEVICES ON ALL UNUSED BOXES.
- 6. SEE SHEET ME-1.0 FOR LEGEND.



DRAWN BY MWCGI.COM COPYRIGHT © 2019 - Lechtenberg Consulting, Inc. PROJECT NUMBER This document and the Mechanical and Electrical Designs incorporated herein is an Instrument of Professional Service and as such is the property of 18-019 Lechtenberg Consulting, Inc. It shall not be used in whole or in part for any other project without the written authorization of Lechtenberg Consulting, Inc. DOCUMENT RELEASE DATES 0 1/8" Divisions 1" Graphic Scale 2" 1/10" Divisions 3" BIDS & CONST. 3-15-19 NOTE: If the above graphic scale does not measure as noted, the drawing is not printed to scale. ADJUST MEASUREMENTS ACCORDINGLY LEGHON P.O. Box 6483. Lake Charles, LA, 70606 Fax 337.474.5757 Branch Office 7999 Gladys Ave. Suite 101B, Beaumont, TX. 77706 409.860.9226 Texas Firm License #3228 COPYRIGHT © 2019 THE LABICHE ARCHITECTURAL GROUP, INC.

AND DESIGNS INCORPORATED HEREIN, AS AN INSTRUMENT OF PROFESSIONAL SERVICE, IS THE PROPERTY OF THE ARCHITECT AND 19 NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT, WITHOUT THE WRITTEN AUTHORIZATION OF THE LABICHE ××××××× DATE SIGNED --.--2019 REGISTRATION EXPIRATION DATE